# JEFFERSON ~ LOT 5 REDWOOD CITY, CA



#### SHEET INDEX


	ARCHITECTURE
A1	FIRST FLOOR PLAN
A2	SECOND FLOOR PLAN
A3	ROOF PLAN
A4	EXTERIOR ELEVATIONS
A5	SECTION
A6	F.A.R. BLOCK DIAGRAM
A7	COLOR SCHEME
	CIVIL
C-1	TOPOGRAPHIC SURVEY PLAN
C-2	SITE PLAN
C-3	PRELIMINARY GRADING AND DRAINAGE PLAN
C-4	EROSION AND SEDIMENTATION CONTROL PLAN
C-5	COUNTY STANDARD EROSION
	AND SEDIMENTATION CONTROL DETAILS
C-6	CONSTRUCTION BEST MANAGEMENT
	PRACTICES PLAN
	LANDSCAPE
L1.0	CALLOUT & LAYOUT PLAN
L2.0	LANDSCAPE DETAILS
L3.0	PLANTING PLAN
L4.0	IRRIGATION PLAN
L4.1	IRRIGATION LEGEND & NOTES
L4.2	IRRIGATION DETAILS
L4.3	IRRIGATION DETAILS
L4.4	IRRIGATION SPECIFICATIONS

MARCH 1, 2021



3361 Walnut Blvd. Suite 120 Brentwood, CA 94513 925.634.7000 | sdgarchitectsinc.com



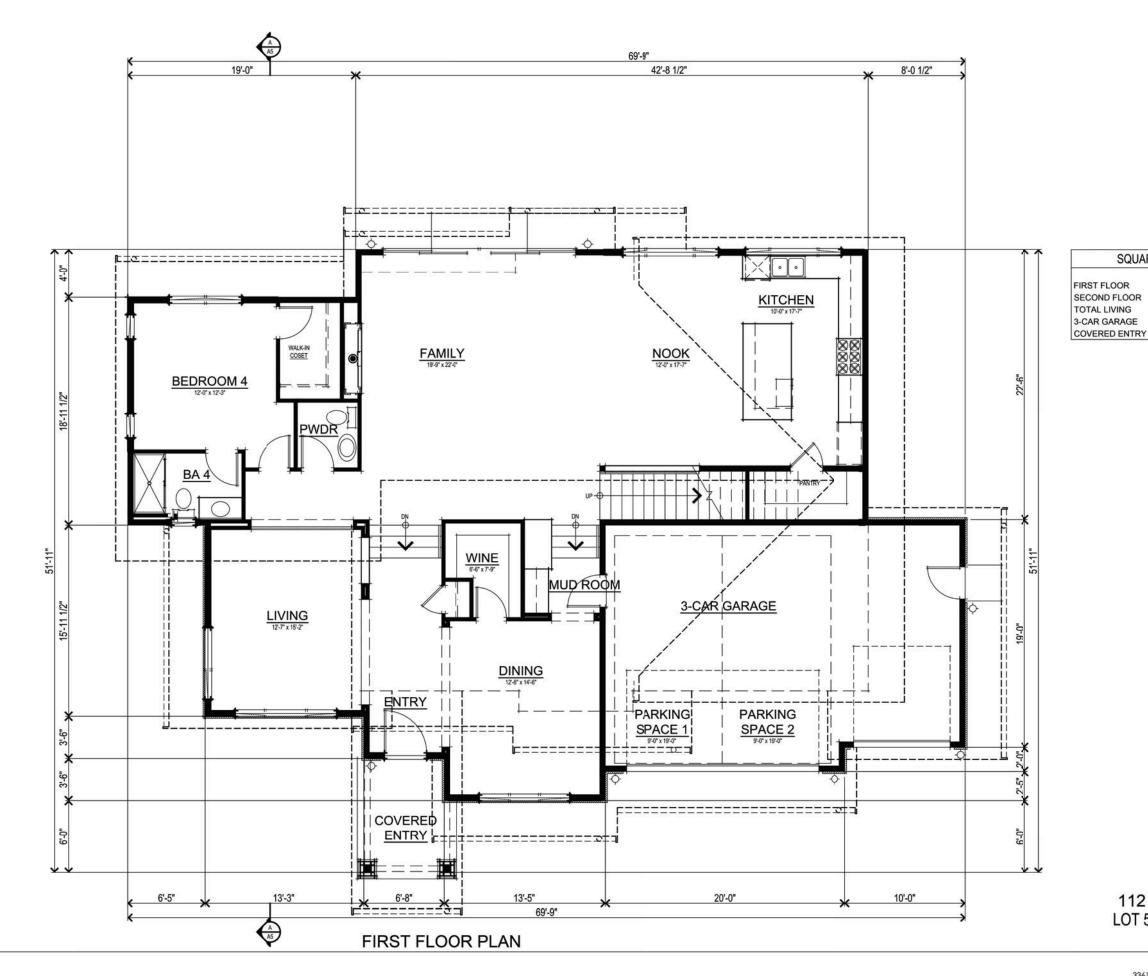

EH Jefferson Redwood City, CA March 1, 2021

Edenbridge Homes

SDG Architects, Inc. 3361 Walnut Blvd. Suite 120 Brentwood, CA 94513

112 WIKA RANCH CT

LOT 5 FIRST FLOOR PLAN

SQUARE FOOTAGES


1990 SQ. FT.

1854 SQ. FT.

3844 SQ. FT.

598 SQ. FT.

67 SQ. FT.

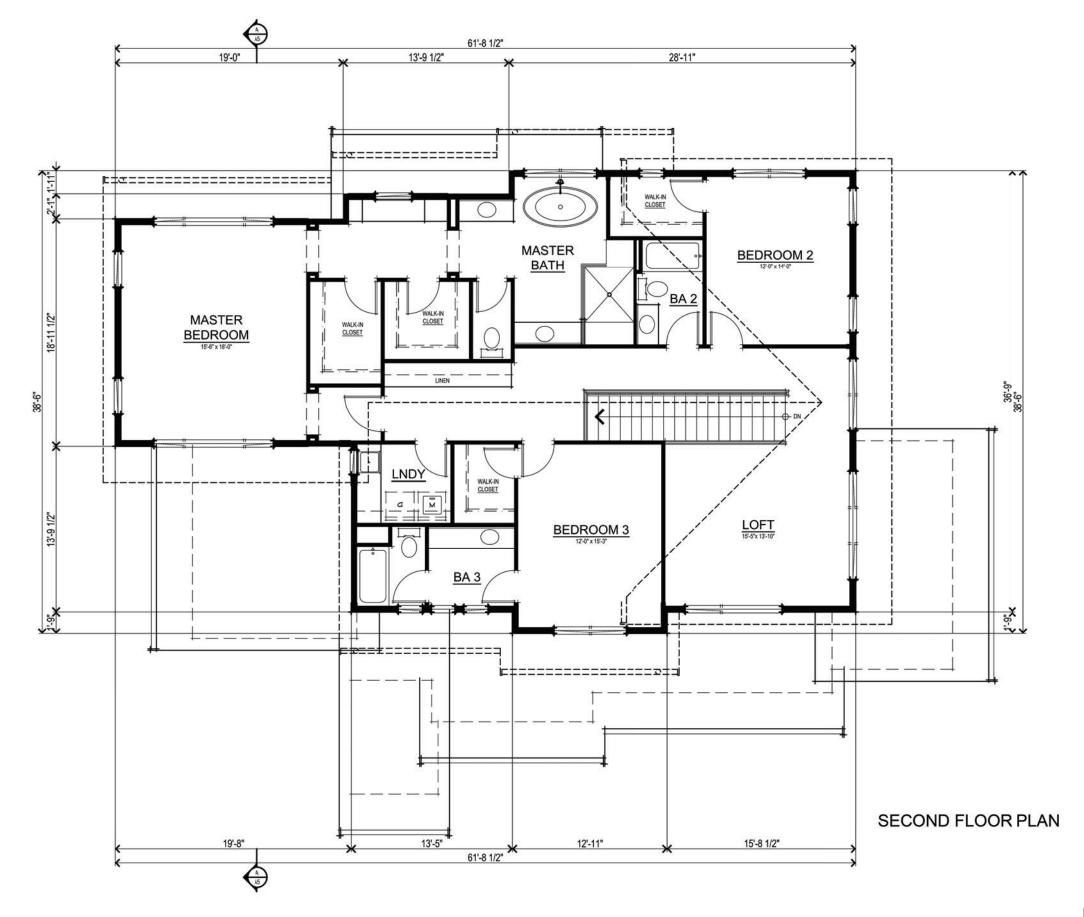





112 WIKA RANCH CT LOT 5 SECOND FLOOR PLAN

A2

Edenbridge Homes

EH Jefferson Redwood City, CA March 1, 2021

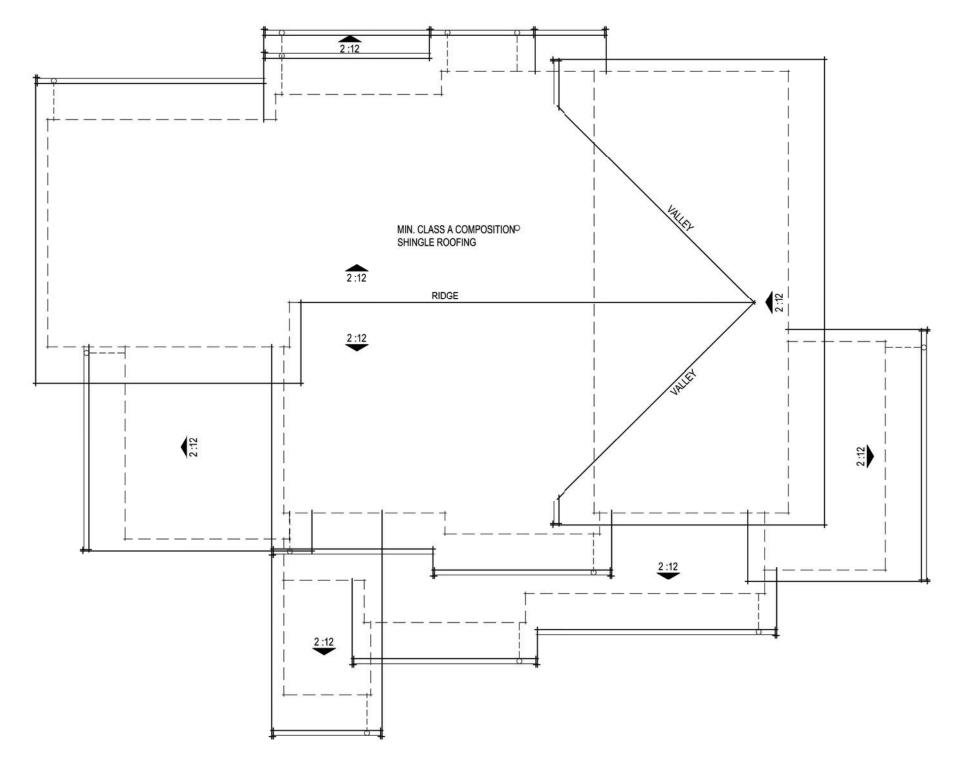



**ROOF PLAN** 

112 WIKA RANCH CT LOT 5 ROOF PLAN

A3

Edenbridge Homes

EH Jefferson Redwood City, CA March 1, 2021





EXTERIOR MATERIALS

\*MUST MEET MIN. REQUIREMENTS FOR VERY
HIGH FIRE HAZARD SEVERITY ZONE

- 3-COAT STUCCO EXTERIOR FINISH
- HORIZONTAL SIDING
- APPLIED STONE VENEER ACCENTS
- MIN. CLASS A COMPOSITION SHINGLE ROOFING

**EXTERIOR ELEVATIONS** 

112 WIKA RANCH CT LOT 5 ELEVATIONS


FRONT ELEVATION

A4

Edenbridge Homes

EH Jefferson Redwood City, CA March 1, 2021




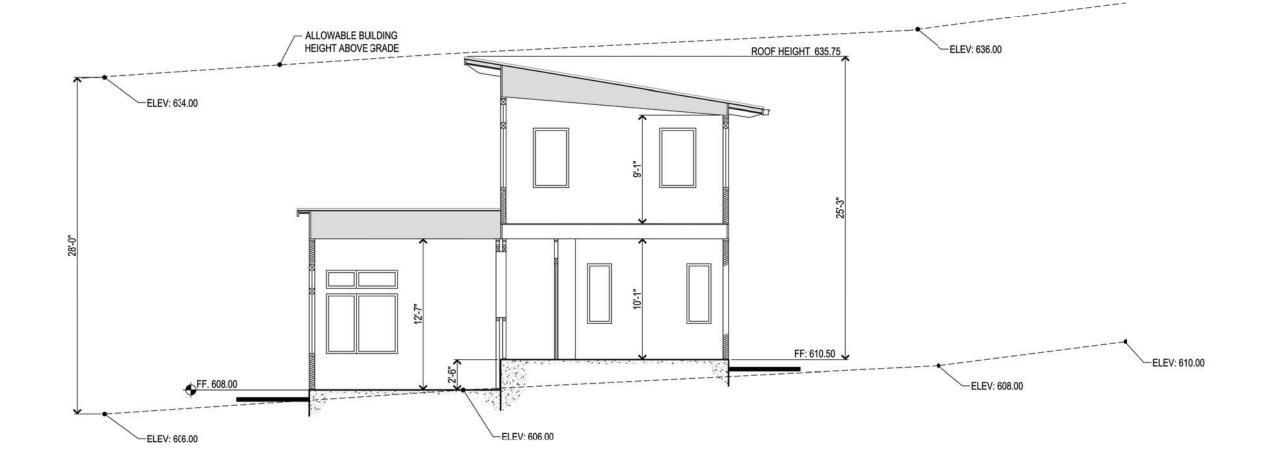

0 1' 2' 3' 4'

ARCHITECTURAL SECTION


EH Jefferson Redwood City, CA March 1, 2021 112 WIKA RANCH CT LOT 5 SECTION

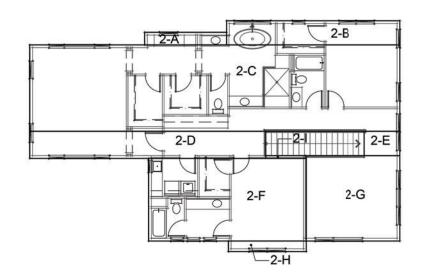

FLOOR AREAS					
LABEL	DIMENSION	AREA			
1-A	19'-0" x 18'-11 1/2"	360 SQ. FT.			
1-B	42'-8 1/2" x 22'-11 1/2"	980 SQ. FT.			
1-C	19'-11" x 15'-11 1/2"	318 SQ. FT.			
1-D	13'-5" x 22'-11 1/2"	309 SQ. FT.			
1-E	6'-8" x 3'-6"	23 SQ. FT.			
G-A	21'-11 1/2" x 18'-6 1/2"	406 SQ. FT.			
G-B	8'-1/2" x 19'-0"	152 SQ. FT.			
G-C	20'-0" x 2'-0"	40 SQ. FT.			
P-A	6'-8" x 3'-6"	23 SQ. FT.			
P-B	7'-2" x 6'-0"	44 SQ. FT.			
2-A	13'-9 1/2" x 4'-0"	29 SQ. FT.			
2-B	28'-11" x 4'-0"	116 SQ. FT.			
2-C	61'-8 1/2" x 14'-6"	895 SQ. FT.			
2-D	39'-3 1/2" x 4'-5 1/2"	175 SQ. FT.			
2-E	5'-11" x 4'-0"	24 SQ. FT.			
2-F	26'-4" x 13'-9 1/2"	365 SQ. FT.			
2-G	15'-8 1/2" x 14'-3"	224 SQ. FT.			
2-H	12'-11" x 1'-9"	23 SQ. FT.			
2-1	6'-8 1/2" x 5 1/2"	3 SQ. FT.			

FIRST FLOOR (1-A - 1-E )	1990 SQ. FT
SECOND FLOOR (2-A - 2-I)	1854 SQ. FT
GARAGE (G-A - G-C)	598 SQ. FT
PORCH (P-A - P-B)	67 SQ. FT
TOTAL	4509 SQ. FT
F.A.R. RATIO	
LOT SIZE	15176 SQ. FT
MAX F.A.R. (30%)	4553 SQ. FT
PROPOSED F.A.R.	4509 SQ. FT

LOT COVERAGE APPLICABLE CA	LCULATED AREA
FIRST FLOOR (1-A - 1-E )	1990 SQ. FT.
GARAGE (G-A - G-C)	598 SQ. FT
PORCH (P-A - P-B)	67 SQ. FT.
TOTAL	2655 SQ. FT.
LOT COVERAGE RA	TIO
LOT SIZE	15176 SQ. FT.
MAX LOT COVERAGE (25%)	3794 SQ. FT.
PROPOSED LOT COVERAGE	2655 SQ. FT.

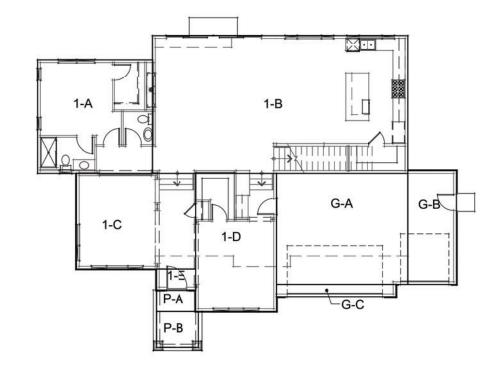






EH Jefferson Redwood City, CA March 1, 2021 112 WIKA RANCH CT LOT 5 F.A.R. BLOCK DIAGRAM





EH Jefferson Redwood City, CA March 1, 2021

SATURE SE SERVE TOURSEY

112 WIKA RANCH CT LOT 5 COLOR SCHEME

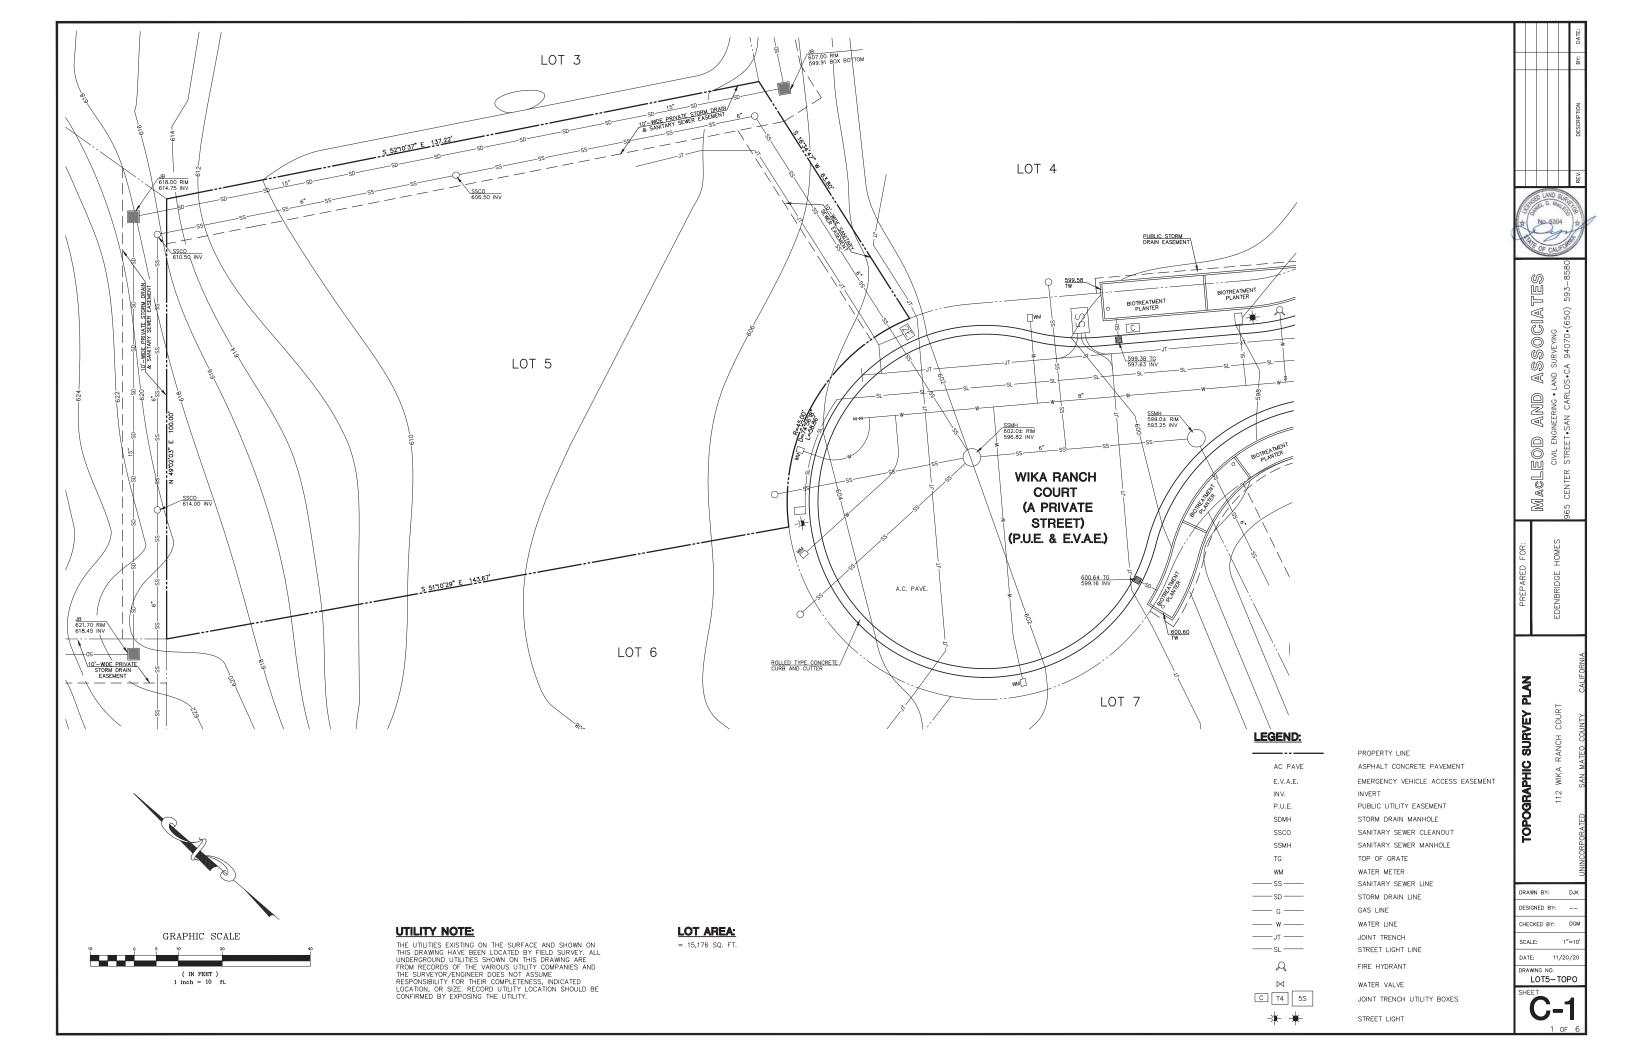

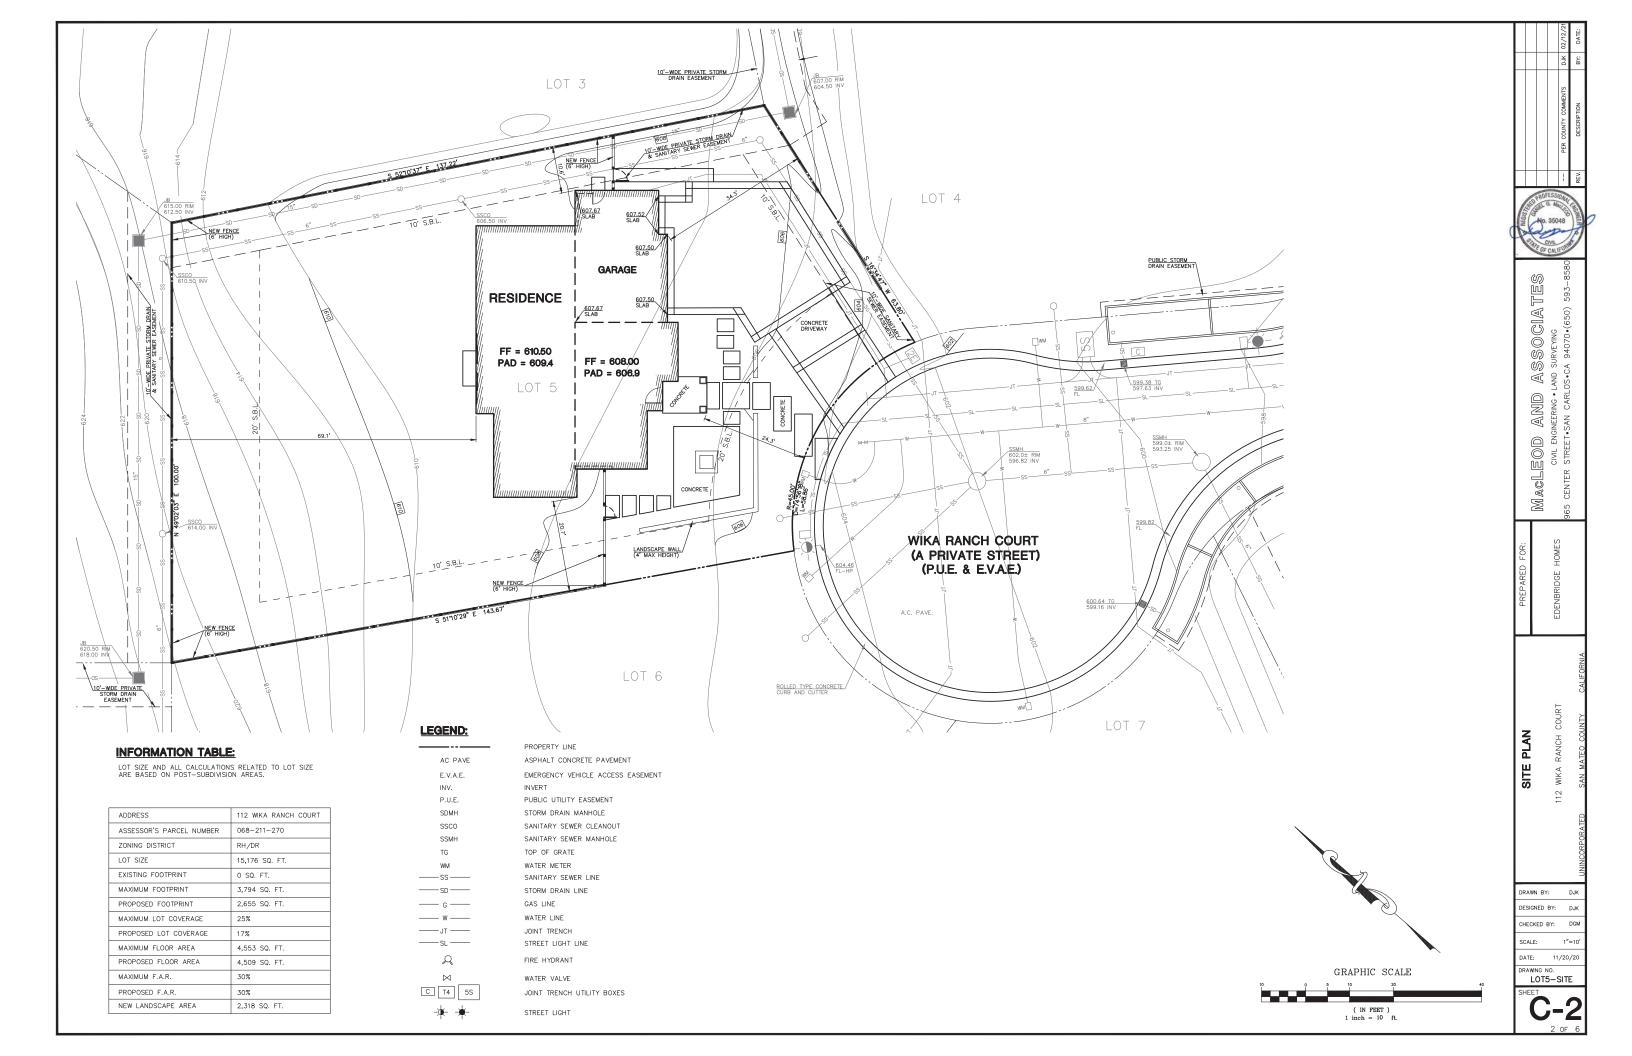

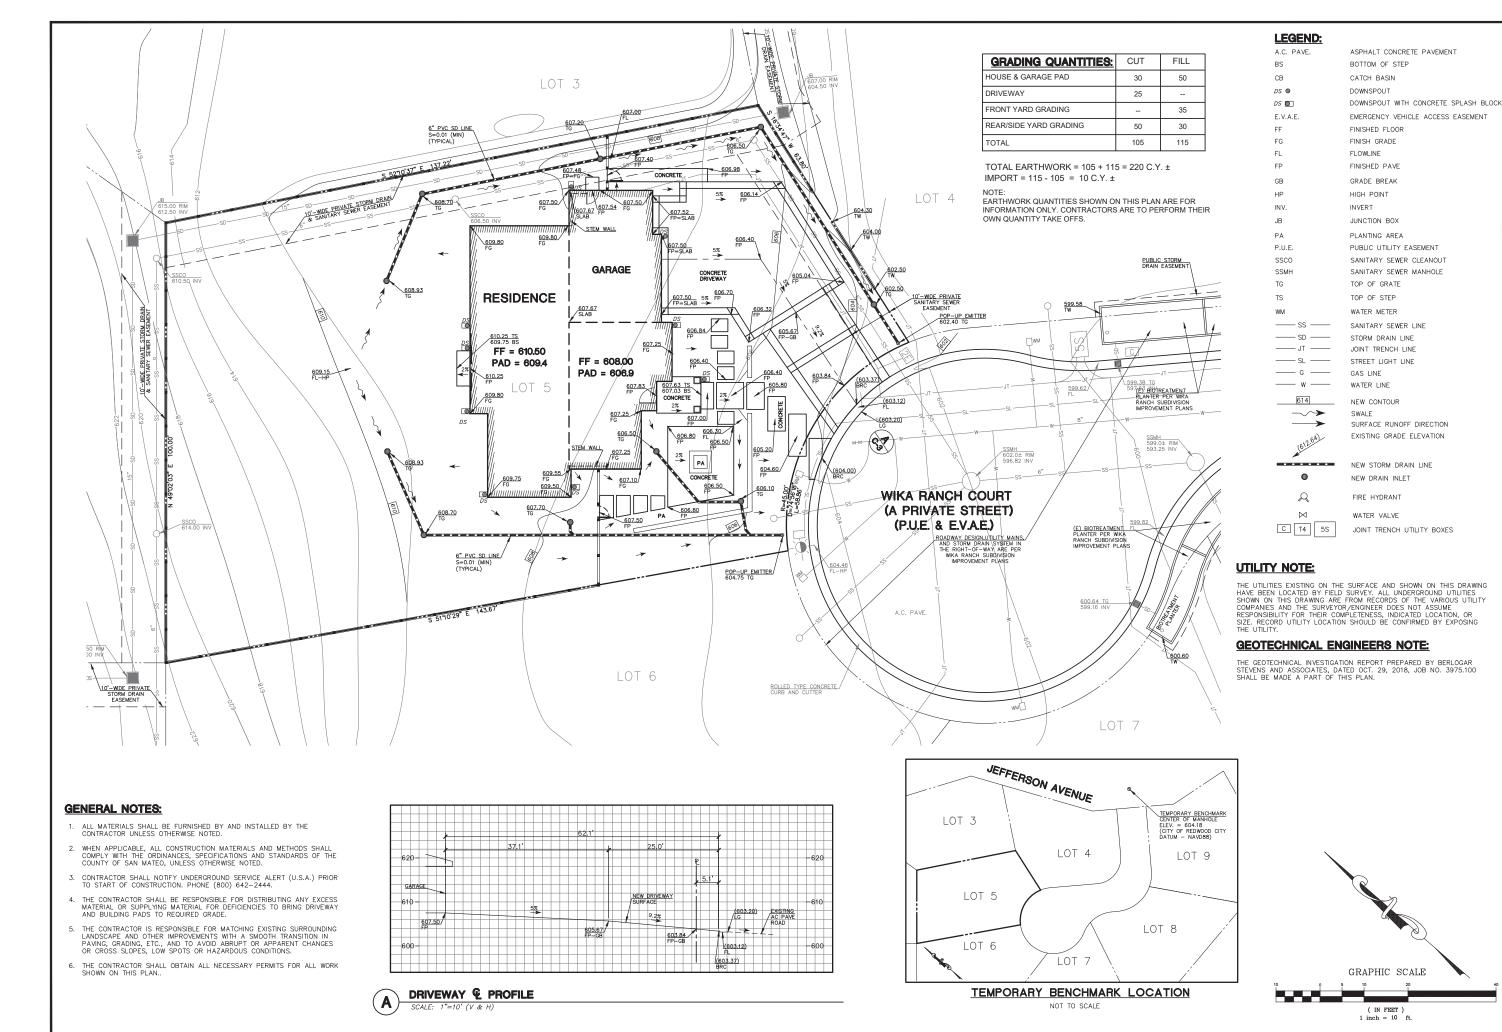

SSOCIA  $\triangleleft$ 

AND acL.

 $\mathbb{Z}$ 

DRAINAGE

GRADING / PLAN


AND

**PRELMINARY** 

DRAWN BY: ESIGNED BY: CHECKED BY: SCALE: 11/20/20

LOT5-GRAD

RAWING N

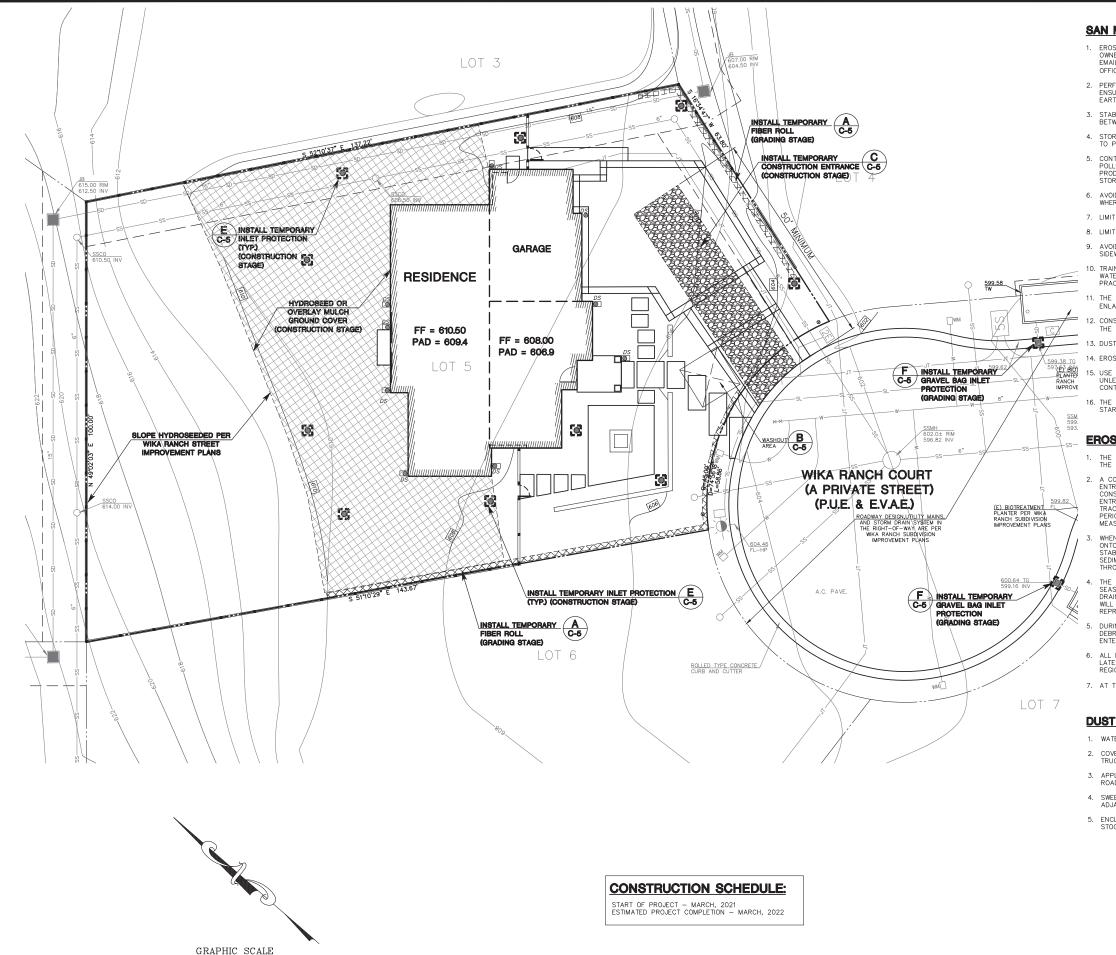

#### **SAN MATEO COUNTY STANDARD NOTES:**

- 1. EROSION CONTROL POINT OF CONTACT OWNER: EDENBRIDGE HOMES EMAIL: eric@edenbridgehomes.com OFFICE: (669) 231-4240
- 2. PERFORM CLEARING AND EARTH—MOVING ACTIVITIES ONLY DURING DRY WEATHER. MEASURES TO ENSURE ADEQUATE EROSION AND SEDIMENT CONTROL SHALL BE INSTALLED PRIOR TO EARTH—MOVING ACTIVITIES AND CONSTRUCTION
- 3. STABILIZE ALL DENUDED AREAS AND MAINTAIN EROSION CONTROL MEASURES CONTINUOUSLY BETWEEN OCTOBER 1 AND APRIL 30.
- 4. STORE, HANDLE, AND DISPOSE OF CONSTRUCTION MATERIALS AND WASTES PROPERLY, SO AS TO PREVENT THEIR CONTACT WITH STORMWATER.
- CONTROL AND PREVENT THE DISCHARGE OF ALL POTENTIAL POLLUTANTS, INCLUDING PAVEMENT CUITING WASTES, PAINTS, CONCRETE, PETROLEUM PRODUCTS, CHEMICAL, WAST WATER OR SEDIMENTS AND NON-STORMWATER DISCHARGES TO STORM DRAINS AND WATERCOURSES.
- AVOID CLEANING, FUELING, OR MAINTAINING VEHICLES ON—SITE, EXCEPT IN A DESIGNATED AREA WHERE WASH WATER IS CONTAINED AND TREATED.
- 7. LIMIT AND TIME APPLICATIONS OF PESTICIDES AND FERTILIZERS TO PREVENT POLLUTED RUNOFF
- 8. LIMIT CONSTRUCTION ACCESS ROUTES TO STABILIZED, DESIGNATED ACCESS POINTS.
- AVOID TRACKING DIRT OR OTHER MATERIALS OFF-SITE; CLEAN OFF-SITE PAVED AREAS AND SIDEWALKS USING DRY SWEEPING METHODS.
- 10. TRAIN AND PROVIDE INSTRUCTION TO ALL EMPLOYEES AND SUBCONTRACTORS REGARDING THE WATERSHED PROTECTION MAINTENANCE STANDARDS AND CONSTRUCTION BEST MANAGEMENT PRACTICES.
- 11. THE AREAS DELINEATED ON THE PLANS FOR PARKING, GRUBBING, STORAGE ETC., SHALL NOT BE
- 12. CONSTRUCTION SITES ARE REQUIRED TO HAVE EROSION CONTROL METERIALS ON-SITE DURING THE "OFF-SEASON"
- 13. DUST CONTROL IS REQUIRED YEAR-ROUND.
  - 14. EROSION CONTROL MATERIALS SHALL BE STORED ON-SITE.
- 15. USE OF PLASTIC SHEETING BETWEEN OCTOBER 1st. AND APRIL 30th IS NOT ACCEPTABLE, UNLESS FOR USE ON STOCKPILES WHERE THE STOCKPILE IS ALSO PROTECTED WITH FIBER ROLLS CONTAINING THE BASE OF THE STOCKPILE.
- 16. THE TREE PROTECTION SHALL BE IN PLACE BEFORE ANY GRADING, EXCAVATING OR GRUBBING IS STARTED.

#### **EROSION CONTROL NOTES:**

- THE INTENT OF THE EROSION CONTROL PLAN IS TO MINIMIZE ANY WATER QUALITY IMPACTS IN THE FORM OF SEDIMENT POLLUTION TO  $\,$  MAIN CREEK & TRIBUTARIES.
- 2. A CONSTRUCTION ENTRANCE WILL BE INSTALLED PRIOR TO OF GRADING. LOCATION OF THE ENTRANCE MAY BE ADJUSTED BY THE CONTRACTOR TO FACILITATE GRADING OPERATIONS. ALL CONSTRUCTION TRAFFIC ENTERING THE PAVED ROAD MUST CROSS THE CONSTRUCTION ENTRANCE. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS— OF—WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITION DEMAND, AND REPAIR OF ANY MEASURES USED TO TRAP SEDIMENTS.
- WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RIGHT—OF WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WHICH DRAINS INTO AN APPROVED SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH THE USE OF SAND BAGS, GRAVEL, BOARDS OR OTHER APPROVED METHODS.
- THE EROSION AND SEDIMENT CONTROL MEASURES WILL BE OPERABLE DURING THE RAINY SEASON, OCTOBER 1 TO APRIL 15. BY OCTOBER 1, GRADING AND INSTALLATION OF STORM DRAINAGE AND EROSION AND SEDIMENT CONTROL FACILITIES WILL BE COMPLETED, NO GRADING WILL OCCUR BETWEEN OCTOBER 1 AND APRIL 15 UNLESS AUTHORIZED BY THE COUNTY
- 5. DURING THE RAINY SEASON, ALL PAVED AREAS WILL BE KEPT CLEAR OF EARTH MATERIAL AND DEBRIS. THE SITE WILL BE MAINTAINED SO THAT A MINIMUM OF SEDIMENT-LADEN RUNOFF ENTERS THE STORM DRAINAGE SYSTEM.
- ALL EROSION AND SEDIMENTATION CONTROL MEASURES SHALL BE IN ACCORDANCE WITH THE LATEST EDITION OF THE EROSION AND SEDIMENT CONTROL FIELD MANUAL OF THE CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD.
- 7. AT THE CONTRACTOR'S DISCRETION SILT FENCES MAY BE INSTALLED INSTEAD OF FIBER ROLLS.

#### **DUST CONTROL NOTES:**


- 1. WATER ALL CONSTRUCTION AND GRADING AREA AT LEAST TWICE DAILY.
- COVER ALL TRUCKS HAULING SOIL, SAND, AND OTHER LOOSE MATERIALS, OR REQUIRE ALL TRUCKS TO MAINTAIN AT LEAST 2 FEET OF FREEBOARD.
- APPLY WATER TWO TIMES DAILY, OR APPLY (NON-TOXIC) SOIL ON ALL UNPAYED ACCESS ROADS, PARKING AREAS, AND STAGING AREAS AT THE PROJECT SITE.
- 4. SWEEP STREETS DAILY (WITH WATER SWEEPERS) IF VISIBLE SOIL MATERIAL IS CARRIED ONTO
- ENCLOSE, COVER, WATER TWICE DAILY, OR APPLY (NON-TOXIC) SOIL BINDERS TO EXPOSED STOCKPILES (DIRT, SAND, ETC.).


ంద

EROSI


RAWING N LOT5-GRAD








**TEMPORARY WASHOUT PIT** SCALE: (NOT TO SCALE)

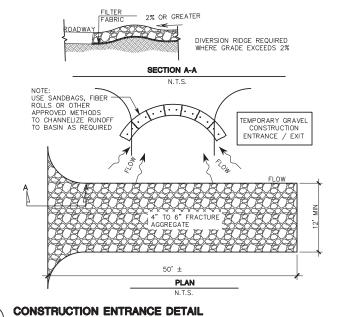


#### DESIGN AND CONSTRUCTION SPECIFICATIONS FOR CONSTRUCTION ENTRANCE:


- 1. THE MATERIAL FOR CONSTRUCTION OF THE PAD SHALL BE 4 TO 6 INCH STONE.
- 2. THE THICKNESS OF THE PAD SHALL NOT BE LESS THAN 12 INCHES.
- 3. THE WIDTH OF THE PAD SHALL NOT BE LESS THAN THE FULL WIDTH OF ALL POINTS OF INGRESS AND EGRESS.
- 4. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RICHT-OF-WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH ADDITIONAL STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEANUP OF ANY MEASURES USED TO TRAP SEDIMENT. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS—OF—WAY SHALL BE REMOVED IMMEDIATELY.

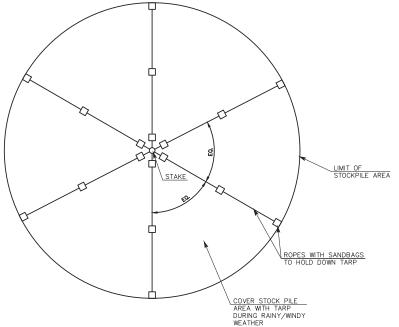

STOCKPILE AREA DETAIL D SCALE: (NOT TO SCALE)



DRAIN INLET PROTECTION DETAIL SCALE: (NOT TO SCALE)



SAND BAG DRAIN INLET PROTECTION DETAIL

ASSOCIATES Land surveying Los.ca 94070.(650) 593—858 AND

MacLEOD

EROSION AND SEDIMENTATION CONTROL DETAILS

DRAWN BY: DESIGNED BY: CHECKED BY: SCALE: DATE: 11/20/20

LOT5-GRAD

DRAWING NO

SCALE: (NOT TO SCALE)

REMOVED IMMEDIATELY.

5. WHEN NECESSARY, WHEELS SHALL BE CLEANED TO REMOVE SEDIMENT PRIOR TO ENTRANCE ONTO PUBLIC RICHTS—OF—WAY. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE WHICH DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY STORM DRAIN, DITCH, OR WATERCOURSE THROUGH USE OF SAND BAGS, GRAVEL, BOARDS, OR OTHER APPROVED METHODS.

6. WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN.




### **Construction Best Management Practices (BMPs)**

Construction projects are required to implement the stormwater best management practices (BMP) on this page, as they apply to your project, all year long.

Clean Water. Healthy Community.

#### Materials & Waste Management



#### Non-Hazardous Materials

- ☐ Berm and cover stockpiles of sand, dirt or other construction material with tarps when rain is forecast or if not actively being used within
- ☐ Use (but don't overuse) reclaimed water for dust control.

#### Hazardous Materials

- ☐ Label all hazardous materials and hazardous wastes (such as pesticides, paints, thinners, solvents, fuel, oil, and antifreeze) in accordance with city, county, state and federal regulations.
- ☐ Store hazardous materials and wastes in water tight containers, store in appropriate secondary containment, and cover them at the end of every work day or during wet weather or when rain is forecast.
- ☐ Follow manufacturer's application instructions for hazardous materials and be careful not to use more than necessary. Do not apply chemicals outdoors when rain is forecast within 24 hours.
- ☐ Arrange for appropriate disposal of all hazardous wastes.

#### Waste Management

- ☐ Cover waste disposal containers securely with tarps at the end of every work day and during wet weather.
- ☐ Check waste disposal containers frequently for leaks and to make sure they are not overfilled. Never hose down a dumpster on the construction site
- ☐ Clean or replace portable toilets, and inspect them frequently for leaks and spills
- ☐ Dispose of all wastes and debris properly. Recycle materials and wastes that can be recycled (such as asphalt, concrete, aggregate base materials, wood, gyp board, pipe, etc.)
- ☐ Dispose of liquid residues from paints, thinners, solvents, glues, and cleaning fluids as hazardous waste.

#### **Construction Entrances and Perimeter**

- ☐ Establish and maintain effective perimeter controls and stabilize all construction entrances and exits to sufficiently control erosion and sediment discharges from site and tracking off site.
- ☐ Sweep or vacuum any street tracking immediately and secure sediment source to prevent further tracking. Never hose down streets to clean up tracking.

#### **Equipment Management & Spill Control**




#### Maintenance and Parking

- ☐ Designate an area, fitted with appropriate BMPs, for vehicle and equipment parking and storage.
- ☐ Perform major maintenance, repair jobs, and vehicle and equipment washing off site.
- ☐ If refueling or vehicle maintenance must be done onsite, work in a bermed area away from storm drains and over a drip pan or drop cloths big enough to collect fluids. Recycle or dispose of fluids as hazardous waste.
- ☐ If vehicle or equipment cleaning must be done onsite, clean with water only in a bermed area that will not allow rinse water to run into gutters, streets, storm drains, or surface waters.
- ☐ Do not clean vehicle or equipment onsite using soaps, solvents, degreasers, or steam cleaning equipment.

#### Spill Prevention and Control

- ☐ Keep spill cleanup materials (e.g., rags, absorbents and cat litter) available at the construction site at all times.
- ☐ Inspect vehicles and equipment frequently for and repair leaks promptly. Use drip pans to catch leaks until repairs are made.
- ☐ Clean up spills or leaks immediately and dispose of cleanup materials properly.
- Do not hose down surfaces where fluids have spilled. Use dry cleanup methods (absorbent materials, cat
- ☐ Sweep up spilled dry materials immediately. Do not try to wash them away with water, or bury them.
- ☐ Clean up spills on dirt areas by digging up and properly disposing of contaminated soil.
- ☐ Report significant spills immediately. You are required by law to report all significant releases of hazardous materials, including oil. To report a spill: 1) Dial 911 or your local emergency response number, 2) Call the Governor's Office of Emergency Services Warning Center, (800) 852-7550 (24 hours).

#### **Earthmoving**



- ☐ Schedule grading and excavation work during dry weather.
- ☐ Stabilize all denuded areas, install and maintain temporary erosion controls (such as erosion control fabric or bonded fiber matrix) until vegetation is established.
- ☐ Remove existing vegetation only when absolutely necessary, and seed or plant vegetation for erosion control on slopes or where construction is not immediately planned.
- ☐ Prevent sediment from migrating offsite and protect storm drain inlets, gutters, ditches, and drainage courses by installing and maintaining appropriate BMPs, such as fiber rolls, silt fences, sediment basins, gravel bags, berms, etc.
- ☐ Keep excavated soil on site and transfer it to dump trucks on site, not in the streets.

#### **Contaminated Soils**

- ☐ If any of the following conditions are observed, test for contamination and contact the Regional Water Quality Control Board:
- Unusual soil conditions, discoloration,
- Abandoned underground tanks.
- Abandoned wells
- Buried barrels, debris, or trash.

#### Paving/Asphalt Work



- Avoid paving and seal coating in wet weather or when rain is forecast, to prevent materials that have not cured from contacting stormwater runoff.
- ☐ Cover storm drain inlets and manholes when applying seal coat, tack coat, slurry seal, fog seal, etc.
- ☐ Collect and recycle or appropriately dispose of excess abrasive gravel or sand. Do NOT sweep or wash it into gutters.
- ☐ Do not use water to wash down fresh asphalt concrete pavement.

#### Sawcutting & Asphalt/Concrete Removal

- ☐ Protect nearby storm drain inlets when saw cutting. Use filter fabric, catch basin inlet filters, or gravel bags to keep slurry out of the storm drain system.
- ☐ Shovel, abosorb, or vacuum saw-cut slurry and dispose of all waste as soon as you are finished in one location or at the end of each work day (whichever is
- ☐ If sawcut slurry enters a catch basin, clean it up immediately.

#### Concrete, Grout & Mortar Application




- ☐ Store concrete, grout, and mortar away from storm drains or waterways, and on pallets under cover to protect them from rain, runoff, and wind
- ☐ Wash out concrete equipment/trucks offsite or in a designated washout area, where the water will flow into a temporary waste pit, and in a manner that will prevent leaching into the underlying soil or onto surrounding areas. Let concrete harden and dispose of as
- ☐ When washing exposed aggregate, prevent washwater from entering storm drains. Block any inlets and vacuum gutters, hose washwater onto dirt areas, or drain onto a bermed surface to be pumped and disposed of properly.

#### Landscaping



- ☐ Protect stockpiled landscaping materials from wind and rain by storing them under tarps all year-round.
- ☐ Stack bagged material on pallets and under cover.
- ☐ Discontinue application of any erodible landscape material within 2 days before a forecast rain event or during wet weather.

#### Painting & Paint Removal



#### Painting Cleanup and Removal

- ☐ Never clean brushes or rinse paint containers into a street, gutter, storm drain, or stream
- ☐ For water-based paints, paint out brushes to the extent possible, and rinse into a drain that goes to the sanitary sewer. Never pour paint down a storm drain.
- ☐ For oil-based paints, paint out brushes to the extent possible and clean with thinner or solvent in a proper container. Filter and reuse thinners and solvents. Dispose of excess liquids as hazardous waste.
- ☐ Paint chips and dust from non-hazardous dry stripping and sand blasting may be swept up or collected in plastic drop cloths and disposed of as trash.
- ☐ Chemical paint stripping residue and chips and dust from marine paints or paints containing lead, mercury, or tributyltin must be disposed of as hazardous waste. Lead based paint removal requires a statecertified contractor

#### **Dewatering**



- ☐ Discharges of groundwater or captured runoff from dewatering operations must be properly managed and disposed. When possible send dewatering discharge to landscaped area or sanitary sewer. If discharging to the sanitary sewer call your local wastewater treatment plant.
- ☐ Divert run-on water from offsite away from all disturbed areas
- ☐ When dewatering, notify and obtain approval from the local municipality before discharging water to a street gutter or storm drain. Filtration or diversion through a basin, tank, or sediment trap may be required.
- ☐ In areas of known or suspected contamination, call your local agency to determine whether the ground water must be tested. Pumped groundwater may need to be collected and hauled off-site for treatment and proper disposal.



SSOCIATES

ARE AND SL S.CA 6 AND


MACLEOD


CONSTRUCTION BEST MANAGEMENT PRACTICES PLAN

RAWN BY: ESIGNED BY: CHECKED BY: SCALE:

LOT5-CBMPF

Storm drain polluters may be liable for fines of up to \$10,000 per day!

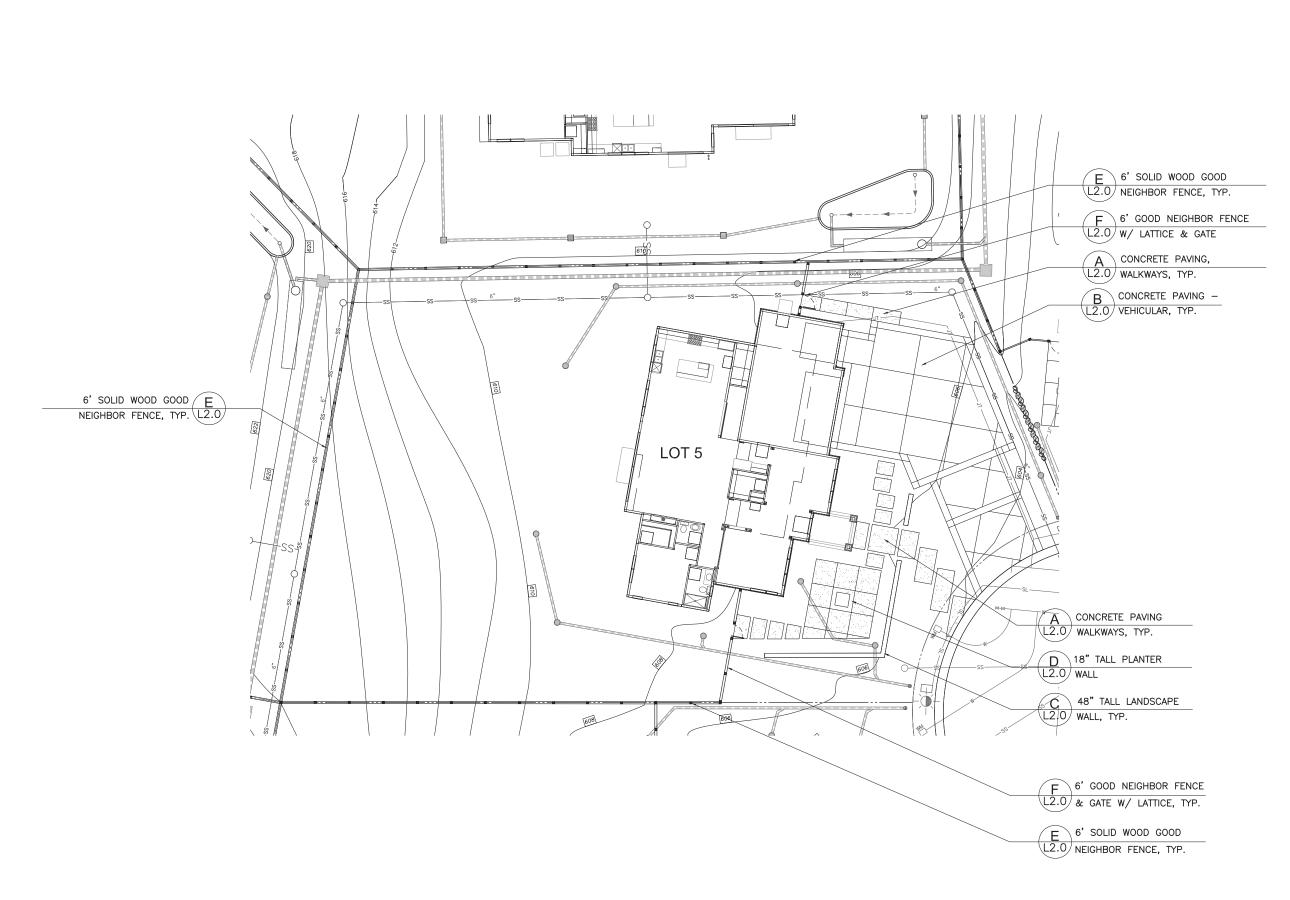










PROJECT NAME/DOCATION:
JEFFERSON AVE. SUBDIVISION
LOT 5 nte:
LANDSCAPE
CONSTRUCTION DRAWINGS SAN MATEO COUNTY DRAWING TITLE:

SHEET TILE:
CALLOUT &
LAYOUT PLAN

SCALE:
1" = 10'-0"
ISSUE DATE:
11/24/2020
PROJECT NO:
V1831
SHEET NO.:

L1.0

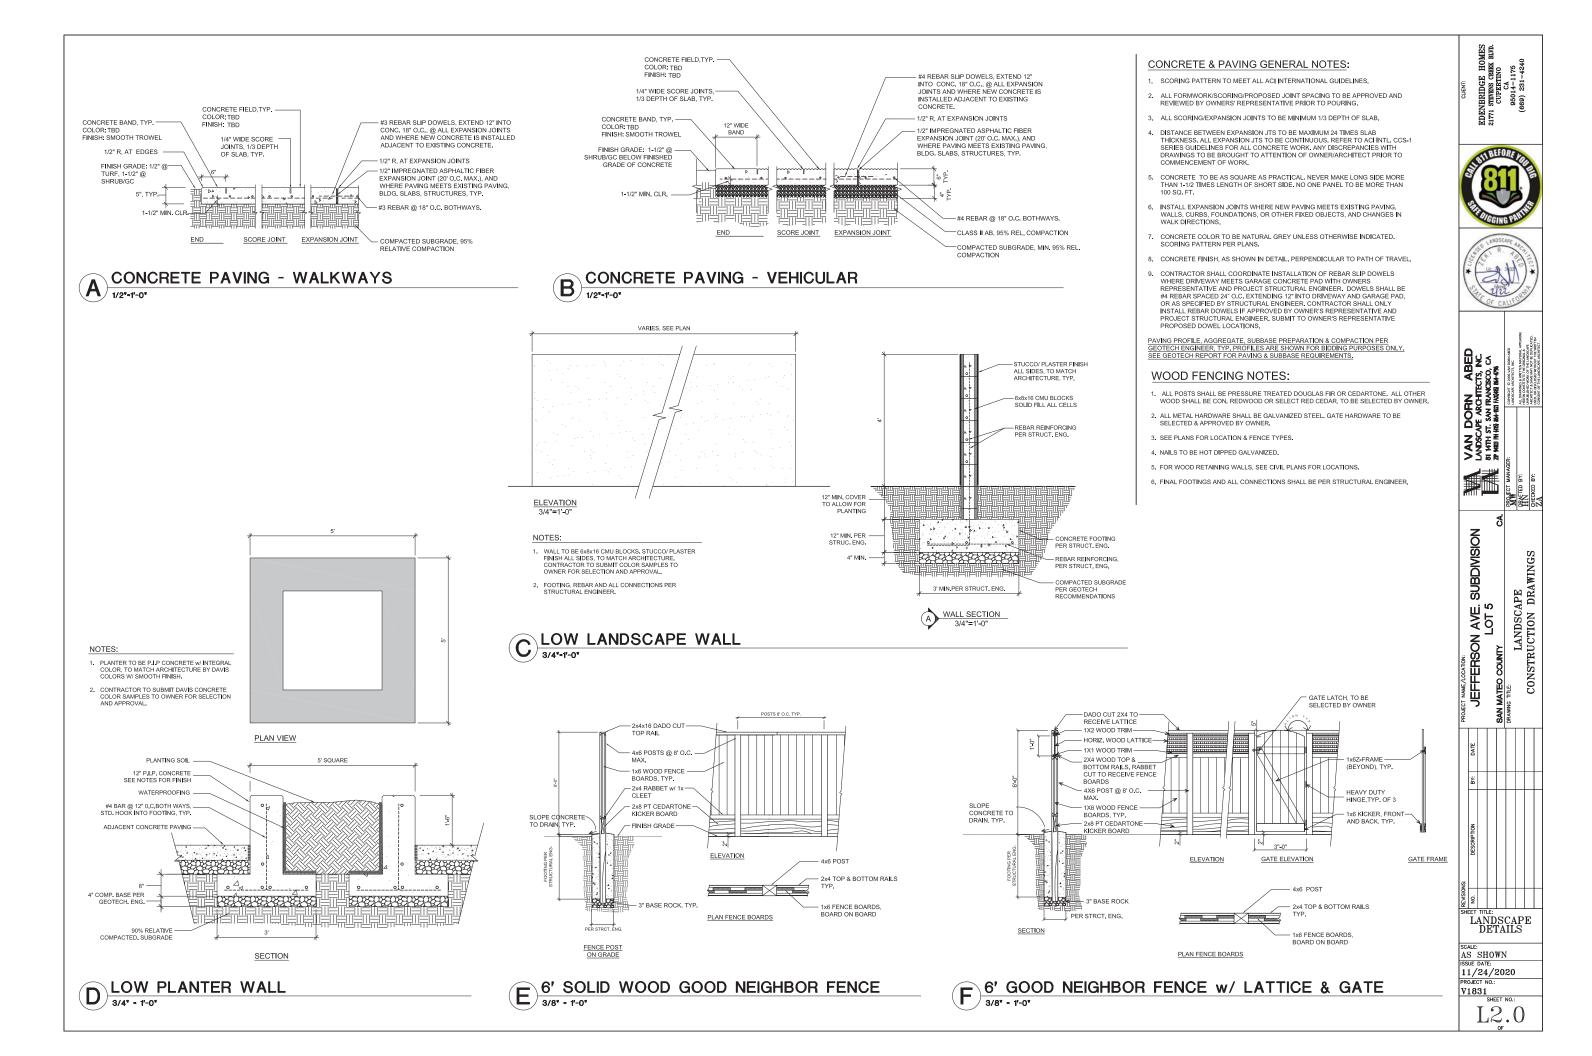

#### **PLANTING NOTES:**

- 1. TOTAL NEW LANDSCAPE AREA = 2444 S.F. MWELO: PRESCRIPTIVE APPROACH (LESS THAN 2500 S.F.)

TURF SHALL NOT EXCEED 25% OF THE LANDSCAPE AREA IN RESIDENTIAL AREAS. NO TURF PERMITTED IN NON-RESIDENTIAL AREAS. TURF NOT PERMITTED ON SLOPES GREATER THAN 25%,
TURF NOT PERMITTED ON SLOPES GREATER THAN 25%,
TURF IS PROHIBITED IN PARKWAYS LESS THAN 10 FEET WIDE.
NOTE: THERE IS NO TURF IN THE LANDSCAPE DESIGN.

- 3. SEE IRRIGATION PLAN L4.0 AND IRRIGATION LEGEND & NOTES L4.1 FOR THE LOW AND MEDIUM HYDROZONE AREAS AND WATER EFFICIENT LANDSCAPE WORKSHEET (WATER USE CALCULATIONS)
- 4. UNLESS CONTRADICTED BY A SOILS TEST, FOR SOILS LESS THAN 6% ORGANIC MATTER IN THE TOP 6 INCHES OF SOIL, COMPOST AT A RATE OF A MINIMUM FOUR CUBIC YARDS PER 1,000 S.F. OF PERMEABLE AREA SHALL BE INCORPORATED TO A DEPTH OF SIX INCHES INTO THE SOIL.
- 5. A MINIMUM 3" LAYER MULCH TO BE APPLIED TO ALL EXPOSED SOIL SURFACES OF PLANTING AREAS, EXCEPT TURF AREAS, CREEPING OR ROOTING GROUNDCOVERS & SUCCULENTS, OR DIRECT SEEDING APPLICATIONS WHERE MULCH IS CONTRAINDICATED.
- 6. THE CERTIFICATE OF COMPLETION IS REQUIRED PRIOR TO FINAL BUILDING INSPECTION WHICH INCLUDES THE REQUIRED ADDITIONAL ITEMS (PARTS 2-6 PER SMC MODEL WATER EFFICIENT LANDSCAPE ORDINANCE):

  - PART 2. CERTIFICATION OF INSTALLATION ACCORDING TO THE LANDSCAPE DOCUMENTATION PACKAGE
  - PART 3. IRRIGATION OF INTELLINE ACCORDING OF THE LAND PART 3. IRRIGATION SCHEDULING PART 4. SCHEDULE OF LANDSCAPE AND IRRIGATION MAINTENANCE PART 5. LANDSCAPE IRRIGATION AUDIT REPORT PART 6. SOIL MANAGEMENT REPORT

BOTANICAL NAME

Ginkgo Biloba - Princeton Sentry

- 7. REQUIRED STATEMENTS AND CERTIFICATIONS:

- REQUIRED STATEMENTS AND CERTIFICATIONS:

  I HAVE COMPLIED WITH THE CRITERIA OF THE ORDINANCE AND APPLIED THEM FOR THE EFFICIENT USE OF WATER IN THE LANDSCAPE DESIGN PLANS.

  A DIAGRAM OF THE IRRIGATION PLAN SHOWING HYDROZONES SHALL BE KEPT WITH THE IRRIGATION CONTROLLER FOR SUBSEQUENT MANAGEMENT PURPOSES.

  AT THE TIME OF FINAL INSPECTION, THE PERMIT APPLICANT MUST PROVIDE THE OWNER OF THE PROPERTY WITH A CERTIFICATE OF COMPLETION, CERTIFICATE OF COMPLETION SHALL BE FILLED OUT AND CERTIFIED SHALL BE FILLED OUT AND CERTIFIED SHETHER THE DESIGNER OF THE LANDSCAPE PLANS, IRRIGATION PLANS, OR THE LICENSED LANDSCAPE CONTRACTOR OF THE PROPELY.

COMMON NAME

QTY REMARKS

M, 50`H x 15`-20`W Sunset Zones: 1-10, 12, 14-24

CONT


AN IRRIGATION AUDIT REPORT SHALL BE COMPLETED AT THE TIME OF FINAL INSPECTION

#### PLANT SCHEDULE

CODE

REPLACEMENT TREES

w tw						0411001 2011001 1 10, 12, 112
(R·)	MEL QUI	Melaleuca quinquenervia	Cajeput Tree	15 gal	2	L, 20`-40`H x 15`-25`W Sunset Zones: 9, 12, 13, 15-17, 20-24
	QUE AGR	Quercus agrifolia	Coast Live Oak	24"box	1	VL, 20`-70`H x 30`-70`W Sunset Zones: 7-9, 14-24
$\left( \overrightarrow{R_{+}}\right)$	TRI WAT	Tristania laurina	Water Gum	15 ga <b>l</b>	3	M, 10`-45`H x 15`-30`W Sunst Zones: 15-24
			TOTAL REP	LACEMENT TREES:	7	
TREES	CODE	BOTANICAL NAME	COMMON NAME	CONT	QTY	REMARKS
( Constant	CAT SOU	Catalpa bignoniodes	Southern Catalpa	24¹box	1	M, 30`-4-`H x 30`-40`W Sunset Zones: 3-10, 14-24
Source Services	MAG AL2	Magnolla x soulanglana `Alexandrina`	Saucer Magnolla MultI-Trunk	36" BOX MULTI	1	M, 20`-25`H x 20`-25`W Sunset Zones: 2b-10, 12-24
$\bigcirc$	OLE SK4	Olea europaea `Skylark Dwarf`	Dwarf Fruitless European Olive	24"box	1	VL, 16`H x 16`W Sunset Zones: 8, 9, 11-24
SHRUBS	CODE	BOTANICAL NAME	COMMON NAME	SIZE	QTY	REMARKS
+	ANI YEL	Anlgozanthos x `Yellow Gem`	Ye∎ow Gem Kangaroo Paw	5 gal	46	WUCOLS: L Sunset Zones: 15-24
	CIS PRO	Clstus salvilfollus `Prostratus`	Sageleaf Rockrose	5 gal	5	WUCOLS: L Sunset Zones: 4-9, 14-24
( Command	CIT MEY	Citrus x limon `Meyer`	Meyer Lemon	15 ga <b>l</b>	3	L - dwarf fruiting standard
\.\.\.\.\.\.\.\.\.\.\.\.\.\.\.\.\.\.\.	COP PUM	Coprosma pumila `Verde Vista`	Creeping Coprosma	5 gal	8	WUCOLS: L Sunset Zones: 8, 9, 14-24
$\odot$	COT MIC	Cotoneaster microphyllus	Rockspray Cotoneaster	5 gal	8	WUCOLS: L Sunset Zones: 2-9, 14-24
	DIE VEG	Dletes vegeta	African Irls	5 gal	22	WUCOLS: L Sunset Zones: 8, 9, 12-24
0	EUP GLA	Euphorbla characlas `Glacler Blue`	Evergreen Spurge	5 gal	5	WUCOLS: L Sunset Zones: 4-24
©	FES OVI	Festuca ovina glauca `Elijah Blue`	Blue Fescue	1 gal	146	WUCOLS: L Sunset Zones: 1-24
+	GRE NOE	Grevillea hybrid `Noellii`	Grevillea	5 gal	13	WUCOLS: L Sunset Zones: 8, 9, 12-24

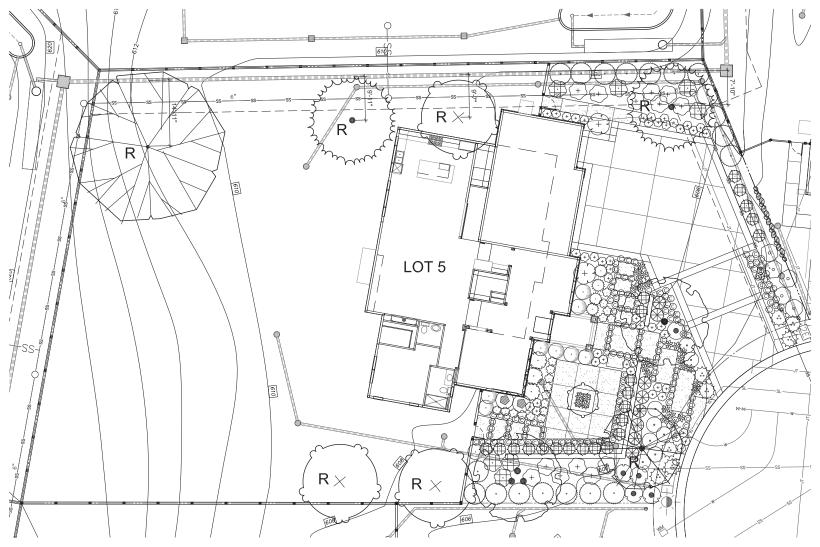

PI ANT	SCHEDULE	CONTINUED
	COLLEDGE	CONTINUED

SHRUBS	CODE	BOTANICAL NAME	COMMON NAME	SIZE	QTY	REMARKS
$\odot$	HEB COE	Hebe `Coed`	Hebe	5 gal	9	WUCOLS: M Sunset Zones: 14-24
$\oplus$	HEM HYB	Hemerocallis hybrid	Flowering Daylity	1 gal	18	WUCOLS: L Sunset Zones: 1-24
+	LAV ASS	Lavatera assurgen <b>tifl</b> ora	Mallow	5 gal	2	WUCOLS: L Sunset Zones: 14-24
	PEN WH2	Pennlsetum setaceum `White`	White Foutain Grass	5 gal	4	WUCOLS: L Sunset Zones: 8-24
器	PHO SPR	Phormlum tenax `Jack Spratt`	New Zealand Flax	5 gal	28	WUCOLS: L Sunset Zones: 7-9, 14-24
$\oplus$	PHO TIN	Phormlum tenax `Tlny Tlger`	Dwarf Flax	5 gal	8	WUCOLS: L Sunset Zones: 7-9, 14-24
$\odot$	PIT VA2	Plttosporum tenulfollum `Varlegatum`	Tawhlwhl	5 gal	19	WUCOLS: M Sunset Zones: 9, 14-17, 19-24
	PIT CM	Plttosporum toblira `Cream De Mint` TM	Cream De Mint Dwarf Mock Orange	5 gal	2	WUCOLS: L Sunset Zones: 8-24
	TAG LE2	Tagetes lemmonii	Copper Canyon Daisy	5 gal	7	WUCOLS: L Sunset Zones: 8-10, 12-24

I have complied with the criteria of the Water Efficient Landscape Ordinance and applied them for the efficient use of water in the Landscape Design Plans



11/24/2020 DATE













SUBDIVISION

LANDSCAPE
CONSTRUCTION DRAWINGS VECT NAME/LOCATION:

JEFFERSON AVE. S

LOT 5 SAN MATEO COUNTY PRAWING TITLE:

SCALE: 1" = 10'-0" 11/24/2020

V1831
SHEET NO.: L3.0

## HYDROZONE LEGEND

- LOW AND MEDIUM WATER USE HYDROZONE AREAS ARE ON SEPARATE DRIP VALVE CIRCUITS.
- MEDIUM WATER USE HYDROZONE IS A MIX OF LOW AND MEDIUM WATER USE SHRUBS.
- LOW AND MED WATER USE TREE HYDROZONES ARE ON SEPARATE DRIP VALVE CIRCUITS, SYMBOL REPRESENTS MULT-OUTLET DRIP EMITTER THAT IS INSTALLED AT EACH TREE.

#### **IRRIGATION PLAN NOTES:**


- 1. AUTOMATIC WEATHER-BASED IRRIGATION CONTROLLER SHALL BE INSTALLED, AS SPECIFIED ON THE IRRIGATION PLAN.
- 2. MANUAL SHUT-OFF GATE VALVE SHALL BE INSTALLED AS CLOSE AS POSSIBLE TO P.O.C. OF WATER SUPPLY.
- 3. CONTRACTOR SHALL VERIFY WATER PRESSURE ON-SITE AS NOTED ON THE IRRIGATION PLAN. SEE "WATER PRESSURE AT P.O.C. NOTES" SHEET L4.1 FOR ADDITIONAL REQUIREMENTS.
- 4. PRESSURE REGULATORS ARE SPECIFIED AT EACH REMOTE CONTROL VALVE, TO ENSURE DYNAMIC PRESSURE OF THE SYSTEM IS WITHIN THE MANUFACTURER'S RECOMMENDED PRESSURE RANGE. DRIP EMITTERS ALSO HAVE BUILT PRESSURE COMPENSATING DEVICES.
- CHECK VALVES OR ANTI-DRAIN VALVES ARE REQUIRED ON ALL EMITTER HEADS WHERE LOW POINT DRAINAGE COULD OCCUR. SEE IRRIGATION NOTES SHEET L4.4.
- 6. AREAS LESS THAN 10-FEET IN WIDTH IN ANY DIRECTION SHALL BE IRRIGATED WITH SUBSURFACE IRRIGATION OR OTHER MEANS THAT PRODUCES NO RUNOFF OR OVERSPRAY-ALL AREAS WILL BE IRRIGATED WITH DRIP IRRIGATION, AS SPECIFIED ON THE IRRIGATION PLAN.
- 7. A DIAGRAM OF THE IRRIGATION PLAN SHOWING HYDROZONES SHALL BE KEPT WITH THE IRRIGATION CONTROLLER FOR SUBSEQUENT MANAGEMENT PURPOSES.
- 8. SEE PLANTING NOTES SHEET L3.0 FOR FINAL INSPECTION CERTIFICATE OF COMPLETION REQUIREMENTS.

#### **IRRIGATION DESIGN INTENT STATEMENT:**

THE IRRIGATION HAS BEEN DESIGNED FOR MAXIMUM EFFICIENCY AND WATER CONSERVATION:

- SMART E.T. BASE IRRIGATION CONTROLLER WITH AUTOMATIC WATER SCHEDULE ADJUSTMENTS DAILY BASED UPON LOCAL SITE CLIMATIC CONDITIONS.
- RAIN SHUTOFF DEVICE.
- LOW VOLUME DRIP EMITTERS AT SHRUB AND GROUND COVER PLANTING AREAS.
- LOW VOLUME DRIP EMITTERS AT TREES.
- SHRUB AND GROUND COVER PLANTING AREAS UTILIZE PRIMARILY WATER CONSERVING LOW WATER USE PLANT MATERIALS. A MIX LOW AND MEDIUM WATER USE PLANT MATERIALS ARE USED IN KEY ACCENT AREAS. THE LOW AND MIXED LOW/MED HYDROZONES ARE ON SEPARATE VALVE CIRCUITS
- TREES CONSIST OF A MIX OF LOW AND MEDIUM WATER USE PLANT MATERIALS. THE LOW AND MEDIUM TREE HYDROZONES ARE ON SEPARATE VALVE CIRCUITS
- THE DIFFERENT HYDROZONES ARE ON SEPARATE VALVE CIRCUITS AS NOTED IN HYDROZONE LEGEND ABOVE.

NOTE: CONTRACTOR SHALL FIELD STAKE ALL TREE LOCATIONS PRIOR TO INSTALLATION OF IRRIGATION SYSTEM TO AVOID CONFLICTS WITH TREE LOCATIONS AND MAIN LINES/LATERAL LINES. IRRIGATION LATERAL LINES AND MAIN LINES SHALL BE LOCATED 3' MINIMUM HORIZONTALLY FROM TREE LOCATIONS, FIELD ADJUST ROUTING OF IRRIGATION LINES AS NECESSARY TO MEET MINIMUM CLEARANCE NOTED ABOVE.

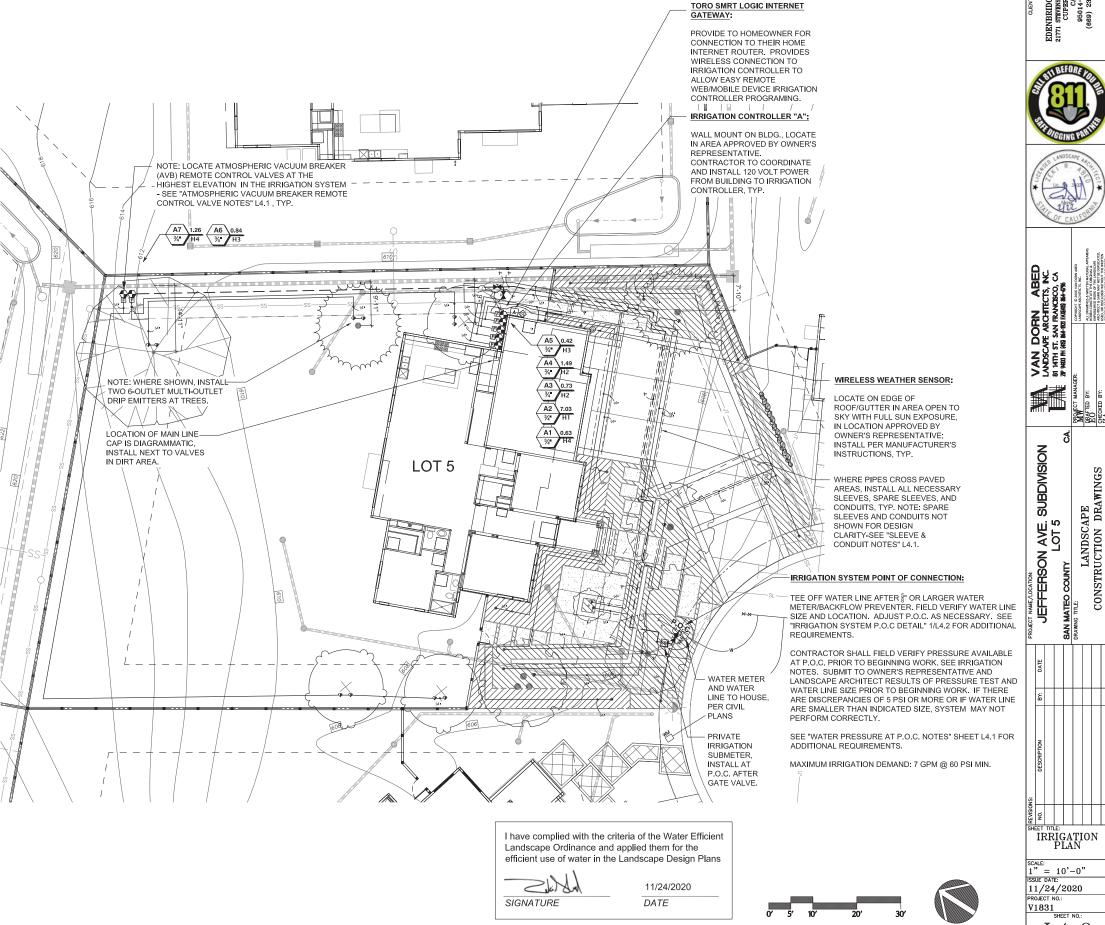







L4.0

IRRIGATION\_SCHEDULE MANUFACTURER/MODEL/DESCRIPTION PVC lateral line to drip area with multi-outlet drip emitters. Route PVC lateral line through drip area and install required quantity of multi-outlet drip emitters necessary to irrigate plants in the drip area. See drip emitters in legend for quantity of emitters at each plant. Contractor shall size lateral HYDROZONE #H3 & #H4 Rain Bird XBT-6 Sk multi-outlet drip emitter/bubbler St-Outlet Pressure Compensating, Drip Emitter, Flow rates of St-Outlet, Pressure Compensating, Drip Emitter, Flow rates of 20ght-red, at each emitter outlet. Comes with 12° PFT Inlet x Barb Outlet, Install 4 emitters it's galon tree; 6 emitters/24" box tree. Where shown on the plans install two Qi ja-coullet drip emitter at trees (this will double the number of emitters at the rees noted). LOW WATER USE (H3) &, MED WATER USE (H4), SUN, DRIP, TREES APPLICATION RATE: 6 4"/HR HYDROZONE #H1 ——LOW WATER USE, SUN, Area to Receive Drip Emitters
Rain Bird XRD81-PRS wXRJ-10,10 gph emitters at
shruk & ground cover areas), 10,4-Bird & Multi Outet Emission
Device with Xerl-Bug emitters at 1gph each, with bull-In 200
mesh titler, Pressure Regulator in stem, Install 1 emitter @1 gal,
plants; 2 emiters @ 5 gal, plants; 4 emitters @ 15 gal, plants,
Frinter Nates\* DRIP, SHRUBS & GC APPLICATION RATE: 0.3"/HR HYDROZONE #H2 MEDIUM WATER USE, PART SUN DRIP SHRUBS & GC APPLICATION RATE: 0.3"/HR MANUFACTURER/MODEL/DESCRIPTION SYMBOL Toro EZF-29-03 3/4\*
3/4\* Electric Remote Control Valve, Jar-Top, with NPT and
Anti-Siphon Model. Install Agrafinm (or eq.) 30 PSI in-line
pressure regulator at valve - see Irrig.details. Lead Free Class 125 bronze gate shut off valve with wheel handle, same size as pipe diameter Toro EVC-040D-SC with (01) EMOD-12
16 Station Outdoor Controller, Includes one 12-station
Expansion Module, With Smart Connect so Controller can
communicate wirelessly with a number of add-on devices, Ideal
for residential and light-commercial applications. Α ® Amlad 150 mesh Black Plastic Y-Filter
with flush valve, 150 PSI rating, or approved equivalent. Insta.
all drip remote control valves. Select filter size with gpm flow
rate compatible P.O.C. Irrigation Lateral Line, PVC Class 200 SDR 21 3/4 with solvent weld Sch.40 fittings. Only lateral transition pipe sizes 1 and above are indicated on the plan, with all others being 3/4" In size. 12" min. burry.

> Irrigation Mainline: PVC Schedule 40 1
>  with solvent weld Sch. 80 fittings. Use PVC Schedule 40 for 1-1/2! and smaller pice sizes (use PVC Class 315 SDR 13.5 for 2 and larger size pipes). 18 mln, bury.

5/8" private irrigation submeter , lead free Neptune or

Cap main line for future use. Install cap in 9" round plastic valve box.

#### **GENERAL NOTES:**

- THIS DESIGN IS DIAGRAMMATIC. ALL PIPING, VALVES, ETC., SHOWN WITHIN PAVED AREAS ARE FOR DESIGN CLARIFICATION ONLY AND SHALL BE INSTALLED IN PLANTING AREAS WHERE POSSIBLE, UNLESS OTHERWISE NOTED. AVOID ANY CONFLICTS BETWEEN THE IRRIGATION SYSTEM, PLANTING AND ARCHITECTURAL FEATURES. LOCATE TURF AREA REMOTE CONTROL VALVE(S) IN SHRUB PLANTING AREAS - DO NOT LOCATE IN TURF AREAS OR BIOSWALE/BIORETENTION AREAS.
- 2. CONTRACTOR SHALL VERIFY P.O.C./METER SIZE AND PRESSURE ON-SITE PRIOR TO BEGINNING WORK. SEE IRRIGATION NOTES FOR TEST REQUIREMENTS. CONTRACTOR SHALL BE RESPONSIBLE FOR ANY CORRECTIVE MEASURES REQUIRED TO IRRIGATION SYSTEM, AT NO ADDITIONAL COST TO THE OWNER, I FIRRIGATION SYSTEM IS INSTALLED WITHOUT REQUIRED TESTS, AND DISCREPANCIES IN PRESSURE AND P.O.C./METER SIZE ARE DISCOVERED THAT PREVENT THE IRRIGATION SYSTEM FROM FUNCTIONING CORRECTLY.

#### WATER PRESSURE AT P.O.C. NOTES:

- CONTRACTOR SHALL VERIFY WATER PRESSURE ON SITE. IF PRESSURE IS 75 PSI OR HIGHER AT P.O.C.'S., CONTRACTOR SHALL INSTALL A PRESSURE REDUCER AFTER GATE VALVE AT POINT OF CONNECTION, AND SET PRESSURE REDUCER TO 65 PSI. PRESSURE REDUCER SHALL BE WILKINS LEAD FREE 500XL-YSBR (INCLUDES PRESSURE REDUCER & FILTER), LINE SIZE, SEE IRRIGATION DETAILS.
- 2. IF PRESSURE IS LESS THAN 75 PSI OMIT PRESSURE REDUCER.
- IF PRESSURE IS LESS THAN 60 PSI NOTIFY OWNER'S REPRESENTATIVE AND LANDSCAPE ARCHITECT FOR CORRECTIVE MEASURES.

#### **SLEEVE & CONDUIT NOTES:**

- FOR DESIGN CLARITY, NOT ALL SLEEVES SHOWN. CONTRACTOR SHALL SLEEVE ALL PIPES CROSSING UNDER PAVED AREAS.
- WHERE LATERAL LINES WITH SLEEVES CROSS ROADS OR DRIVEWAYS, CONTRACTOR SHALL INSTALL ONE SPARE 4" CLASS 315 PVC SLEEVE. SEE IRRIGATION LEGEND FOR BURY DEPTH.
- WHERE MAIN LINES WITH SLEEVES CROSS ROADS OR DRIVEWAYS, CONTRACTOR SHALL INSTALL ONE SPARE 6" CLASS 315 PVC SLEEVE. SEE IRRIGATION LEGEND FOR BURY DEPTH.
- 4. WHERE LOW VOLTAGE CONTROL WIRES CROSS UNDER PAVED AREAS, INSTALL IN SCH.80 ELECTRICAL CONDUIT, 24" MIN. BURY. CONDUIT SIZE SHALL BE 1-1/2" OR LARGER SO WIRES CAN BE EASILY PULLED THROUGH CONDUIT.

#### **IRRIGATION CONTROLLER NOTES:**

- CONTRACTOR SHALL CREATE THE BASELINE PROGRAM, BASED UPON THE HOTTEST MONTH (IULY) AND CREATE A SEPARATE PROGRAM FOR THE PLANT ESTABLISHMENT PEPIDE.
- IRRIGATION CONTROLLER IS AN ET BASED SMART CONTROLLER THAT UTILIZES BASELINE PROGRAM AND ADJUSTS THE RUN TIME SCHEDULE DAILY BASED UPON LOCAL WEATHER CONDITIONS, FOR MAXIMUM WATER EFFICIENCY.

#### ATMOSPHERIC VACUUM BREAKER REMOTE CONTROL VALVE NOTES:

- ATMOSPHERIC VACUUM BREAKER (AVB) REMOTE CONTROL VALVES MUST BE INSTALLED IN A LOCATION SO THAT THEY ARE 12" MINIMUM ABOVE THE HIGHEST ELEVATION SPRINKLER HEAD/DRIP EMITTER(S) IN THE IRRIGATION SYSTEM.
- 2. CONTRACTOR SHALL FIELD VERIFY LOCATION OF HIGHEST SPRINKLER/DRIP EMITTER(S) AND INSTALL THE RCV'S AT A LOCATION WHERE THEY WILL BE 12" MINIMUM ABOVE THE HIGHEST ELEVATION SPRINKLER HEAD/DRIP EMITTER(S) IN THE IRRIGATION SYSTEM. THIS INCLUDES LOCATING RCV'S AT THE TOP OF SLOPE AREAS ADJACENT TO FENCES, LOCATING RCV'S AT A HIGHER LOCATIONS/PAD ELEVATIONS IN THE REAR YARDS. DO NOT LOCATE RCV'S IN THE MIDDLE OF OPEN AREAS LOCATE THEM ADJACENT TO FENCES, PROPERTY LINE, WALLS, HOUSE, ETC. DO NOT LOCATE RCV MORE THAN 24" ABOVE FINISH GRADE.
- 3. THE RCY LOCATIONS INDICATED ON THE IRRIGATION PLANS ARE DIAGRAMMATIC/APPROXIMATE ONLY. CONTRACTOR SHALL FIELD VERIFY CORRECT INSTALLATION LOCATIONS AS NOTED ABOVE.
- 4. RVC'S THAT ARE NOT INSTALLED 12" ABOVE THE HIGHEST ELEVATION SPRINKLER HEAD/DRIP EMITTER(S) IN THE IRRIGATION SYSTEM WILL NOT BE ACCEPTED. SEE IRRIGATION DETAILS.

#### Water Efficient Landscape Worksheet:

This worksheet is filled out by the project applicant and it is a required element of the Landscape Documentation Package.

#### Project Name: Jefferson Lot 5

Reference Evapotranspiration (Eto): 49.5

Factor (PF)	Method ь	Efficiency	(PF/IE)	Area (sq. ft.)		Water Use
		(IE) c				(ETWU) d
3						
0.20	Drip	0.81	0.24691	1,545	381	11,708
0.50	Drip	0.81	0.61728	803	496	15,212
0.20	Drip	0.81	0.24691	36	ÿ	273
0.50	Drip	0.81	0.61728	60	37	1,137
		}				
			Totals	2,444	923	28,330
			0	0	0	(
			0	0	0	(
			0	0	0	(
			Totals	0	0	
					ETWU Total d	28,330
				owed Water Alle	owance	41,253
	b)Irrigi	ation Method	c)Irrigation E)			
	or drip		0.81 for drip			
						per square foot
	0.20 0.50 0.20 0.50	0.20 Drip 0.50 Drip 0.20 Drip 0.50 Drip 0.50 Drip	(EE) (F) (EE) (EE) (EE) (EE) (EE) (EE) (	(IE) c  (IE) c	(IE) = (I	(E) s  0.20

Plant Irrigation Irrigation ETAF Landscape ETAF x Area Estimated

e)MAWA (Annual Gallons Allowed) = ( Eto) ( 0.62) [ (ETAF x LA) + ((1-ETAF) x SLA)]

where 0.62 is a conversion factor that converts acre-inches per acre per year to gallons per square foot per year, LA is the total landscape area in square feet, SLA is the total special landscape area in square feet, and

ETAF used MAWA calculation: 0.55

ETAF used MAWA calculation:

O.55

Average ETAF for Regular Landscape Areas must be 0.55 or below for residential areas, and 0.45 or below for non-residential areas.

Regular Landscape Areas

 Total ETAF x Area
 923

 Total Area
 2,444

 Average ETAF
 0.38

Total Area  Average ETAF	2,444
Total ETAF x Area	923

#### WATER USE CALCULATION NOTES:

- THE LANDSCAPE WATER USE CALCULATIONS COMPLY WITH THE CURRENT CITY
  LANDSCAPE ORDINANCE
- THE ET ADJUSTMENT FACTOR UTILIZED FOR THE MAXIMUM APPLIED WATER ALLOWANCE (MAWA) IS 0.55.
- SEE IRRIGATION PLAN AND IRRIGATION SCHEDULE FOR THE LOW AND MEDIUM WATER USE HYDROZONE AREAS.
- THIS PROJECTS ESTIMATED TOTAL WATER USE (ETWU) IS LESS THAN THE MAXIMUM APPLIED WATER ALLOWANCE (MAWA), THEREFORE THIS PROJECT IS A WATER CONSERVING LANDSCAPE DESIGN.

IDENBRIDGE HOMES

1771 STEVENS CREEK BLVD

CUPERTINO

CA

95014-1175





N DORN ABED
SSCAF ARCHTECTS, NC.
H ST. SAN RANCEO, CA
IN (68) IN-120 (1992) S4-679.
CONTROL OF SENSOR S4-679.
CONTROL OF S



LOI 5
TEC COUNTY
TE LANDSCAPE
CONSTRUCTION DRAWINGS

JEFFERSON AVE. 8

SAN MATEO COUNTY
DEARWING THE

SUBDIVISION

NO IN THE ET TITLE:


TRRIGATION

IRRIGATIO SCHEDULE NOTES SCALE: NA ISSUE DATE: 11/24/2020


V1831
SHEET NO.:

#### IRRIGATION SYSTEM P.O.C. DETAIL

- 1. SEE NOTES ON IRRIGATION PLANS FOR INSTALLATION REQUIREMENTS
- PRESSURE REDUCER SHALL BE LINE SIZE WILKINS LEAD FREE 500XL-YSBR (INCLUDES PRESSURE REDUCER & FILTER), SET AT PSI INDICATED ON IRRIGATION PLANS.

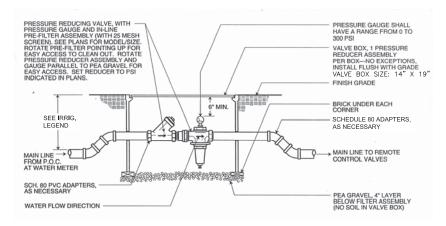


#### PRESSURE REDUCER DETAIL 4 NOT TO SCALE

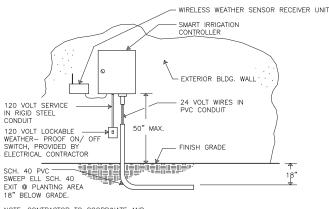


NOTE: CONTRACTOR TO COORDINATE AND INSTALL 120 VOLT POWER FROM BUILDING TO IRRIGATION CONTROLLER

WALL MOUNT IRRIGATION CONTROLLER DETAIL

NOT TO SCALE






#### WIRE CONNECTION DETAIL 5 NOT TO SCALE


GATE VALVE DETAIL

NOT TO SCALE



#### NOTES:

- INSTALL WEATHER SENSOR PER MANUFACTURERS SPECIFICATIONS.
- INSTALL SENSOR OF EDGE OF ROOF IN AREA WITH FULL SUN EXPOSURE, IN LOCATION APPROVED BY OWNER'S REPRESENTATIVE.
- DO NOT LOCATE SENSOR WERE THERE IS SHADE, OR UNDER TREES, OR UNDER EVAE OF






APPLY TEFLON TAPE TO ALL THREADED CONNECTIONS.

2. SEE "ATMOSPHERIC VACUUM BREAKER REMOTE CONTROL VALVE NOTES" ON IRRIGATION PLANS FOR ADDITIONAL REQUIREMENTS.

SCH. 80 PVC NIPPLE. LENGTH AS REQUIRED (2)

FINISH GRADE-

PVC MAINLINE-

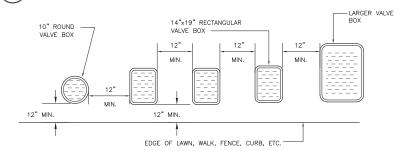

\_\_ATMOSPHERIC VACUUM BREAKER

SCH. 80 PVC
TxT COUPLING
—ARGRAFIA OR APPROVED

SCHEDULE 80 PVC SxT ELL (2)

EQUIVALENT 30 PSI PRESSURE REGULATOR, LINE SIZE.


PVC LATERAL

-150 MESH 'Y' FILTER W/MANUAL FLUSH VALVE

#### TOP VIEW

1. CENTER BOX OVER VALVE TO FACILITATE SERVICING VALVE.

- 3. SET BOXES 1" ABOVE FINISH GRADE OR MULCH COVER IN GROUND COVER/SHRUB AREA AND FLUSH WITH FINISH GRADE IN TURF AREA.
- 4. SET VALVE BOX ASSEMBLY IN GROUND COVER/SHRUB AREA WHERE POSSIBLE. INSTALL IN LAWN AREA ONLY IF GROUND COVER/SHRUB AREA DOES NOT EXIST ADJACENT TO LAWN.
- 5. SET BOXES PARALLEL TO EACH OTHER AND PERPENDICULAR TO EDGE.
- AVOID HEAVILY COMPACTING SOIL AROUND VALVE BOX EDGES TO PREVENT COLLAPSE AND DEFORMATION OF VALVE BOX SIDES.
- 7. VALVE BOXES COLOR SHALL BE GREEN. VALVE BOXES SHALL HAVE BOLT DOWN LIDS WITH BOLTS INSTALLED.
- 8. VALVE BOXES SHALL BE BY CARSON, OR EQUIVALENT.









N DORN ABED ICAPE ARCHITECTS, INC. 1 ST. SAN FRANCISCO, CA HI (85) 66-120 HI (85) 66-175 VAN LANDSCA 81 14TH ST 79 958 FF (6)

SUBDIVISION CONSTRUCTION DRAWINGS FERSON AVE. 9 SAN MATEO COUNTY

IRRIGATION DETAILS AS SHOWN

11/24/2020

V1831 SHEET NO.

WEATHER SENSOR DETAIL (8) WEATHER SCALE





A DORN ABED ICAPE ARCHITECTS, INC. 1 ST. SAN FRANCISCO, CA HI (85) 664-821 FAM(45) 664-675

VAN LANDSCA 81 14TH ST 79 958 FF (6)

SUBDIVISION CONSTRUCTION DRAWINGS TERSON AVE. 9 SAN MATEO COUNTY

IRRIGATION DETAILS

AS SHOWN 11/24/2020 V1831

- CLEAN BEDDING MATERIAL-LIGHTLY COMPACTED - CLEAN BACKFILL MATERIAL-90% COMPACTION REQUIRED SECTION VIEW PIPE AND WIRE SLEEVING oli .0 /o | i 0. 4" AT PEDESTRIAN PROVIDE A MINIMUM OF 2 BETWEEN PIPES PAVING & WIRE W/O 6" AT VEHICULAR PAVING PLAN VIEW

TIE A 24" LOOP IN ALL-

WIRING AT CHANGES IN

DIRECTION OF 30° OR GREATER, UNTIE AFTER

1. PIPE BEDDING & BACKFILL:

- A. A STABLE AND UNIFORM LIGHTLY COMPACTED BEDDING OF AT LEAST 4" SHALL BE PROVIDED FOR THE PIPE AND ANY PROTRUDING FEATURES OF ITS JOINTS AND/OR FITTINGS COVER PIPE WITH AT LEAST 4" LOOSELY PLACED LIGHTLY COMPACTED BEDDING. THE REMAINDER OF THE TRENCH BACKFILL SHALL BE COMPACTED TO A MINIMUM OF 90 PERCENT STANDARD PROCTOR DENSITY.
- B. TRENCH BACKFILL MATERIAL SHALL BE: CLEAN, JOB EXCAVATED MATERIAL.
- PIPE BEDDING MATERIAL SHALL BE: CLEAN, FINELY DIVIDED, CAREFULLY PLACED, JOB EXCAVATED MATERIAL THAT IS FREE FROM DEBRIS, ORGANIC MATERIAL, ROCKS, AND STONES GREATER THAN 1/2-INCH IN ANY DIMENSION.
- SLEEVE BELOW ALL HARDSCAPE ELEMENTS WITH SPECIFIED PVC PIPE AT LEAST TWICE THE DIAMETER OF THE PIPE OR WIRE BUNDLE WITHIN, FOR GASKETED (RING-TITE) MAIN LINES, SLEEVES SHALL BE 2.5 TIMES DIAMETER OF PIPE WITHIN.
- FOR PIPE AND WIRE BURIAL DEPTHS REFER TO IRRIGATION LEGEND AND SPECIFICATIONS.
- CONTRACTOR IS REQUIRED TO CONTACT DIGALERT (CALL 811 OR VIA WEB: WWW.DIGALERT.ORG) 2 DAYS MINIMUM PRIOR TO TRENCHING OPERATIONS.

PIPE AND WIRE TRENCHING DETAIL

ALL SOLVENT WELD

SNAKED IN TRENCH AS SHOWN

PLASTIC PIPING TO BE

NOT TO SCALE

RUN WIRE BENEATH

AND BESIDE MAINLINE.

TAPE AND BUNDLE AT

10-FOOT INTERVALS.

TORO EZF SERIES RCV SIZING CHART

SIZE OF REMOTE REMOTE CONTROL VALVE MAX. GPM FLOW RATES 0 to 7 3/4"

NOTES:

1. DO NOT EXCEED 7 GPM AT RCV.

- CONTRACTOR SHALL BE RESPONSIBLE FOR SIZING RCV'S AT DRIP AREAS, BASED UPON QUANTITY OF EMITTERS/FLOW RATES AT EACH LATERAL DRIP LINE. DO NOT EXCEED MAXIMUM FLOW RATES SHOWN FOR RCV SIZE.
- 3. IF CIRCUITS REQUIRE HIGHER FLOWS THAN MAXIMUM GPM PERMITTED, CONTRACTOR SHALL ADD A NEW REMOTE CONTROL VALVE TO CREATE TWO ZONES WITH LOWER FLOWS.

8 OUTLET DRIP EMITTER AREA LATERAL PIPE SIZING CHART

GPM FLOW RATES	SIZE OF CLASS 200 PVC PIPE	MAX. QUANTITY OF 8-OUTLET EMITTER UNITS WITH 1.0 GPH EMITTERS
0 to 7	3 /4"	52

NOTE: CONTRACTOR SHALL BE RESPONSIBLE FOR SIZING LATERAL LINES AT DRIP AREAS, BASED UPON QUANTITY OF EMITTERS/FLOW RATES AT EACH LATERAL DRIP LINE. DO NOT EXCEED MAXIMUM FLOW RATES HOWN FOR EACH PIPE SIZE. IF CIRCUITS REQUIRE HIGHER FLOWS THAN SHOWN ABOVE CONTRACTOR SHALL ADD A NEW REMOTE CONTROL VALVE.

INSECT/BUG PLUG, LOCATE WITHIN 6" MIN. FROM TRUNK OF TREE OR SHRUB

PLASTIC SUPPORT STAKE

8-OULET ACCESS BOX

8-OUTLET EMITTER UNIT ON RISER, SEE IRRIG. PLAN FOR EMITTER TYPE & FLOW RATE

1/4" BLACK POLY DISTRIBUTION TUBING

1/2" SCHEDULE 80 PVC NIPPLE (LENGTH AS REQUIRED)

1/2" SCHEDULE 80 PVC TEE

LATERAL LINE

1. PLUG UNUSED OUTLETS.

- 2. APPLY TEFLON TAPE TO ALL THREADED CONNECTIONS.
- SEE DRIP LATERAL PIPE SIZING CHART FOR SIZING LATERAL LINES.
- 4. 1/4" DISTRIBUTION TUBING MAXIMUM LENGTH SHALL NOT EXCEED 20'.
- 5. ALL DRIP COMPONENTS (FITTINGS, TUBING, PLUGS, STAKES, BOXES, ETC.) SHALL BE FROM SAME MANUFACTURER AS 8-OUTLET DRIP EMITTER UNIT.

NOTE: TREES AND SHRUBS SHALL BE ON SEPARATE REMOTE CONTROL VALVE (RCV) CIRCUITS. PLASTIC SUPPORT STAKE STAKE 1/4" TUBING AT 2' O.C WITH GALV. METAL STAKES TO SECURE TO FINISH GRADE AS SHOWN INSECT/BUG PLUG INSTALL: EMITTER ® FLATS
EMITTER ® 1 GAL. PLANTS
EMITTERS ® 2 GAL. PLANTS
EMITTERS ® 5 GAL. PLANTS
EMITTERS ® 15 GAL. TREES
EMITTERS ® 24" BOX TREES
EMITTERS © 36" BOX TREES
EMITTERS © 48" BOX TREES SHRUBS, TYPICAL -8-OUTLET EMITTER UNIT (VALVE BOX NOT SHOWN FOR CLARITY)

PLAN VIEW: 8-OUTLET EMITTER LAYOUT @ SHRUBS/GROUND COVERS

8-OUTLET DRIP EMITTER ON RISER DETAIL NOT TO SCALE

**SECTION** 

LOCATE WITHIN 6" OF PLANT TRUNK, IN WATERING BASIN

TREE, TYPICAL PLASTIC SUPPORT STAKE STAKE 1/4" TUBING AT 2' O.C WITH GALV. METAL STAKES TO SECURE TO FINISH GRADE AS SHOWN - INSECT/BUG PLUG

-81-OUTLET EMITTER UNIT (VALVE BOX NOT SHOWN FOR CLARITY), LOCATE 4' MIN. FROM TREE TRUNK PLAN VIEW: 8-OUTLET LAYOUT @ TREES

L4.3

#### **IRRIGATION NOTES:**

- Irrigation system shall be installed in conformance with all applicable local codes and ordinances by experienced workmen
  and a licensed Landscape Contractor who shall obtain all necessary permits and pay all required fees.
- 2. Prior to the start of construction, the Contractor shall verify with the City, Water District, and/or other governing agency(s) if a reclaimed water source will be available in the future for connection to the irrigation system. If local regulations so stipulate, then the Contractor shall follow all requirements, specifications, construction details, codes, etc., for the installation of irrigation systems utilizing reclaimed water sources for irrigation of landscaping.
- The Contractor shall be responsible for any damage to existing facilities caused by or during the performance of his work.All repairs shall be made at no cost to the Owner.
- 4. This design is diagrammatic: install parallel lines in a common trench with minimum horizontal distance of 4" and lines not one above the other. Snake pipe in trenches. All piping, valves, etc., shown within paved areas is for design clarification only and shall be installed in planting areas where possible. Avoid any conflicts between the irrigation system, planting and architectural features.
- 5. Do not willfully install the irrigation system as shown on the drawings when it is obvious in the field that obstructions, grade differences or differences in the area dimensions exist that might not have been considered in the engineering. Such obstructions or differences should be brought to the attention of the Owner's authorized representative. In the event this notification is not performed, the Contractor shall assume full responsibility for any revisions necessary.
- 6. It is the responsibility of the Contractor to familiarize himself with all grade differences, location of walls, retaining walls etc.

  Contractor shall coordinate his work with the General Contractor and other Subcontractors for the location and the installation of pipe sleeves through walls, under roadways, paving, structures, etc.
- 7. Due to the scale of the drawings, it is not possible to indicate all offsets, fittings, sleeves, etc., which may be required. The Contractor shall carefully investigate the structural and finished conditions affecting all of his work and plan his work accordingly, furnishing such fittings, etc., as may be required to meet such conditions. Drawings are generally diagrammatic and indicative of the work to be installed. The work shall be installed in such a manner as to avoid conflicts between irrigation system, planting, and architectural features.
- Notify Landscape Architect of any other aspects of layout which will provide incomplete or insufficient water coverage of plant material and do not proceed until his instructions are obtained.
- Sprinklers/bubblers/multi-out drip emitters located where low head drainage will cause erosion and excess water run-off,
  use pop-up bodies with an integral check valve, and shrub risers with King Bros. CV series check valve in lieu of Schedule
  80 coupling. For drip or bubbler circuits install King Bros. CV series check valve in lateral lines for every 10' of elevation
  change
- 10. Electrical Contractor to supply 120 volt A.C. (2.5 AMP) service to controller location. Contractor to make final connection from electrical stub-out to controller. Paint conduit to controller with 2 coats Rustoleum brown paint if installed outdoors; color to be approved by Owner's representative. 120 volt A.C. J-Box to controller by others. All 120 volt A.C. and 24 volt connections to be made by Contractor.
- 11. Each controller shall have its own independent ground wire.
- 12. Program irrigation controller(s) to operate between the hours specified in the local City/Town/County landscape ordinance.
- 13. Valve locations shown are diagrammatic. Install in ground cover/shrub areas where possible (not in lawn area).
- 14. Install valve boxes 12" from and perpendicular to walk, curb, lawn, building or landscape feature. At multiple valve box groups, each box shall be an equal distance from the walk, curb, lawn, etc., and each box shall be 12" apart. Short side of valve box shall be parallel to walk, curb, lawn, etc.
- 15. For Standard Irrigation Controllers: Install U.L. approved direct-burial wire #14 minimum and #12 common ground at 16" depth minimum. Splicing of 24 volt wires will not be permitted except in valve boxes. Leave a 36" coil of excess wire at each valve box, or group of valve boxes, splices and 100 feet on center along wire run. Tape wire in bundles 10 feet on center. No taping permitted inside sleeves. Install one (1) spare control wire for every 6 (six) stations on the controller along the entire main line. Spare wires shall be different colors than control wires.
- 16. For 2-Wire Irrigation Controllers: Install 2-wire cabling per manufacturer's specifications and notes on the drawings.
- 17. Flow sensor cable shall be per manufacturer's specifications. Install cable in 1" Sch.40 PCV conduit from controller to flow sensor. For 2-Wires controllers, install flow sensor wiring per controller manufacturer's specifications.
- Prior to trenching, call Underground Service Alert, 1-800-642-2444 to locate all cables, conduits, and other utilities and take proper precautions not to damage or disturb existing utilities.
- 19. All Main lines and Lateral lines under paving shall be in PVC sleeves which extend 12" into planting areas. All backfill shall be free of rocks greater than 1" diameter. For ring-tite PVC main line piping inside sleeves use 1120-315 PSI PVC plastic pipe with schedule 40 PVC couplings.
- 20. All main lines shall be flushed prior to the installation of irrigation heads/drip emitters. At 30 days after installation each system shall be flushed to eliminate glue and dirt particles from the lines.
- 21. When applicable, Schedule 80, ASTM D2466 male adapters to be used where mainline connects to copper pipe service lines installed by others.
- 22. Copper pipe shall be joined to steel or cast iron pipe with a dielectric union.
- 23. In addition to the sleeves and conduits shown on the plans the Contractor shall be responsible for the installation of sleeves and conduits of sufficient size under all paved areas.
- 24. Locate bubblers on uphill side of trees. Tree bubblers are for establishment and drought conditions. They are to be turned off after trees are established and turned on during drought conditions.
- 25. Locate quick coupling valve 12" from hardscape area.

- 26. The irrigation system design is based on the minimum operating Pressure (PSI) and Flow (GPM) shown on the drawings (see Imgation Demand at P.O.C. notes). The Contractor shall verify the following:
  - A. Verify water pressure on-site at the irrigation system point of connection (P.O.C.).
  - B. Verify size(s) of irrigation system point of connection. See irrigation plans for P.O.C. type (eg., water meter, service line stubout, etc.)

Submit to Owner's Representative and Landscape Architect results of pressure test, and size(s) of irrigation system point of connection.

Note any discrepancies of 5 PSI or more and irrigation system point of connection size(s) smaller than size(s) indicated on the drawings to Owner's Representative and Landscape Architect.

If there are discrepancies of 5 PSI or more or irrigation system point of connection size(s) smaller than size(s) indicated on the drawings, irrigation system may not perform correctly - do not proceed with irrigation system installation until corrective measures are determined. Note, Contractor shall be responsible for any corrective measures required to the irrigation system, at no additional cost to the Owner, if irrigation system is installed without required verification of on-site water pressure and irrigation system point of connection size(s), and discrepancies in pressure and/or irrigation system point of connection size(s), are discovered that prevent the irrigation system from functioning correctly.

- 27. Meter(s) indicated on the Drawing(s) is supplied and installed by others, unless otherwise indicated. The Contractor is responsible for furnishing all proper fittings.
- 28. All irrigation piping shall be subjected to hydrostatic pressure tests as follows before backfilling trenches: Valves, pumps, and accurately calibrated recording gauges shall be installed in at least two places. Supply lines shall be tested at 125 psi for at least 4 hours with an allowable loss of 5 psi. Laterals lines shall be tested at 100 psi for at least 1 hour with an allowable loss of 5 psi. Any leaks shall be corrected and piping re-tested until the system meet the requirements. The Contractor shall notify the Owner's Representative at least 3 days in advance of the time that the irrigation system piping is to be tested. Submit written test results to Owner's Representative and Landscape Architect.
- 29. Contractor to notify all local jurisdictions for inspection and testing of installed backflow prevention device.
- 30. Irrigation demand: See Irrigation Plans.
- 31. The entire irrigation system shall be operating properly before any lawn or ground cover is planted.
- 32. The Contractor shall provide Owner with a clean set of marked prints of "RECORD DRAWINGS" drawings. Reference all trenches, valves, controllers, splice boxes, quick couplers, backflow preventers, water meters, with dimensions to nearest building or paving.
- 33. See notes on irrigation plans for additional requirements.
- 34. Sod turf and sod no-mow grass areas with buried dripline irrigation tubing shall be hand watered by Contractor until plant material is established.
- 35. Contractor shall guarantee all materials, equipment and workmanship furnished by him to be free of all defects of workmanship and materials, with the exception of repairs and labor cost made necessary by vandalism, and shall agree to replace at his expense, at any time within one year after installation is accepted, any and all defective parts that may be found. Warranty shall also cover repair of damage to any part of the premises resulting from defects, leaks or settling of trenches. It shall be the responsibility of the Contractor to fill and repair all depressions and replace all necessary lawn and planting due to the settlement of irrigation trenches for one year following completion and acceptance of the job. Defects and damage shall be promptly repaired at Contractor's expense to the satisfaction of the Owner's Representative, including the restoration of planting, paving or other improvements.

DENBRIDGE HOME
771 STEVENS CREEK BLV
CUPERTINO
CA
95014-1175





CHECTS, NC.
IFANGSCO, CA.
IFANGS 84-05.
IFANGS 44-05.
IFAN

VAN DORN
LANDSCAPE ARCHI
81 14TH ST. SAN FRA



UEFFERSON AVE. SUBDIVISION

LOT 5

MATEO COUNTY

CANTEL LANDSCAPE

CONSTRUCTION DRAWINGS

DA DESCRIPTION BY: DA

| SET TITLE:
RRIGATION
SPECIFICATION

AS SHOWN
ISSUE DATE:
11/24/2020
PROJECT NO.:
V1831

L4.4